




BD14 Submittal Package

atmosphere is everything

14716 S. BROADWAY, GARDENA, CA 90248 • Ph: (310)532-1555 Fax: (310)-532-3030 • www.marsair.com
© Copyright Mars Air Systems, LLC 2014

BD14 Indirect Gas Fired Heated Series

Belt Drive 14
Industrial Air Curtain
Submittal Package

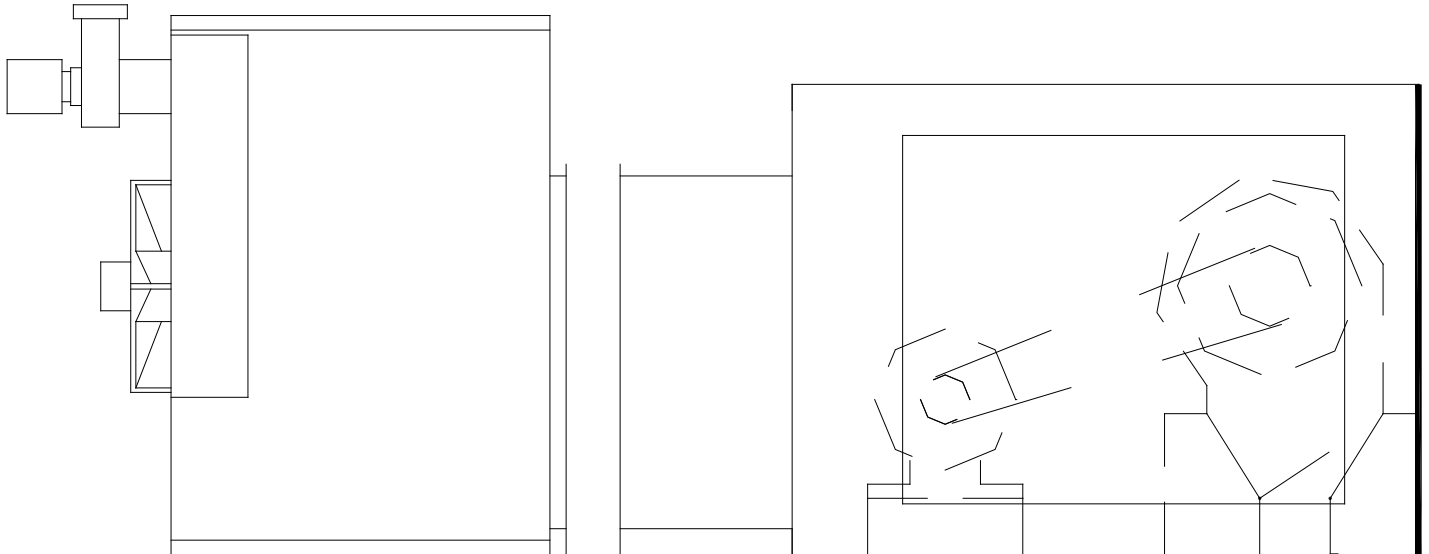

Submitted by:
Mars Air Systems, LLC
14716 S. Broadway
Gardena, CA 90248

| | |
|-------------------|--|
| P.O.# | |
| S.Q. | |
| Company | |
| Print Name | |
| Signature | |
| Date | |

(Electronic Signature Preferred)

Company Seal or Stamp

NOTE: MARS AIR SYSTEMS, LLC reserves the right to change specifications and product design without notice. Such revisions do not entitle the buyer to corresponding changes, improvements, additions, or replacements for previously purchased equipment.

MARS AIR SYSTEMS, LLC • GARDENA, CA • USA



Table of Contents

| <u>Page #</u> | <u>Content</u> |
|---------------|---------------------------------------------------|
| 3-4 | BD14 Indirect Gas Fired Submittals |
| 5-6 | Typical Indirect Gas Fired Wiring Diagrams |
| 7 | Thermostat Submittals |
| 8-9 | Accessory Installation Supplement |
| 10-13 | Installation, Operation and Maintenance |
| 14-15 | Troubleshooting Guide |
| 16 | Warranty |
| 17-18 | Furnace Specifications |
| 19-20 | Heated Products Supplement |
| 21-29 | CSI Spec |
| 30 | Reference Links |



atmosphere is everything


14716 S. Broadway • Gardena, CA 90248 • USA
TEL: (310) 532-1555 • (800) 421-1266 • FAX: (310) 324-3030
Web Site: www.marsair.com • E-mail: info@marsair.com

| | | | | |
|-----------------------|----------------------|--------------|------------|-----------|
| MODEL NO. BD14 Series | DRAWING NO. BD14IG-F | DRAWN BY TVN | CHECKED BY | FILE NAME |
|-----------------------|----------------------|--------------|------------|-----------|


| | | |
|----------|-----------------|------|
| PROJECT | OPTIONS/ITEMS | |
| TITLE | | |
| COMMENTS | DATE 4/21/15 | PAGE |
| | REV. NO | |

Indirect Fired Gas Heated Drawing

BD14 (Belt Driven 14) Series

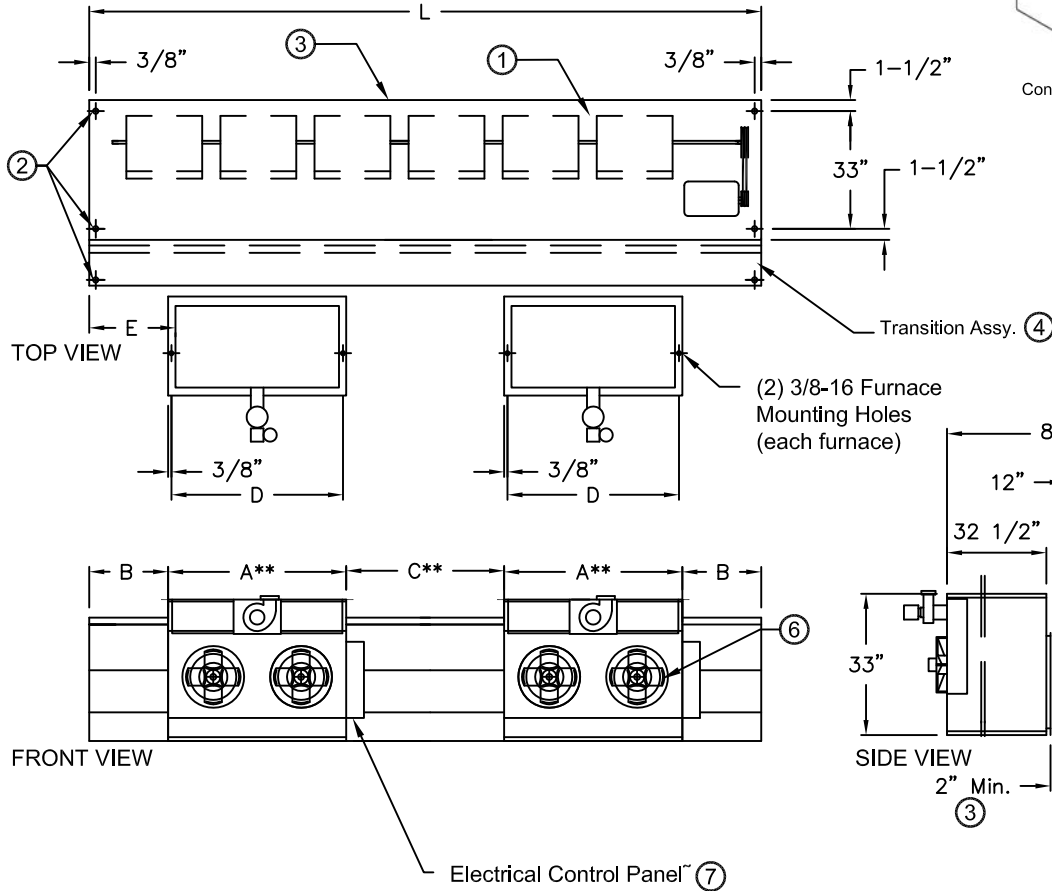

⑧ Recommended Accessories

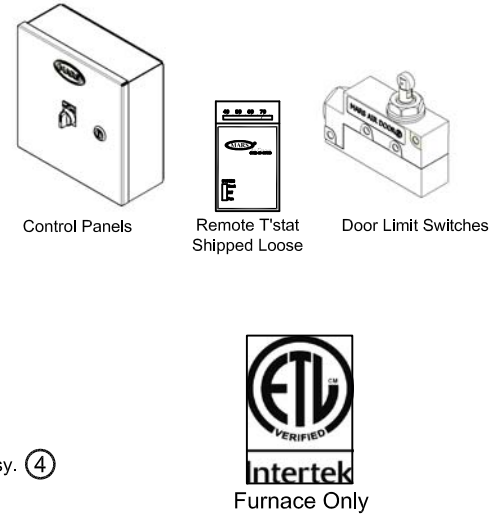

Notes:

Note: MARS reserves the right to change specifications and product design without notice. Such revisions do not entitle the buyer to corresponding changes, improvements, additions or replacements for previously purchased equipment.

*Please see Furnace Submittal for Furnace Data and Dimension Removal of Furnace may be required for servicing and trouble shooting.

*- Use corresponding letters in "Electrical Data" columns to complete the model numbers.

** For 3 furnace models, please add an additional C and A dims

| MODEL NUMBER | Overall Width (in) L | Furnace Width (in) A | End Space (in) B | Center Space (in) C | Mounting Distance (in) D | End Dim (in) E | Furnace Size (MBH) |
|----------------|----------------------|----------------------|------------------|---------------------|--------------------------|----------------|--------------------|
| BD1496-1I*-TS | 107 | 32 3/4 | 10 3/8 | 20 3/4 | 30 5/8 | 11 3/4 | 2 @ 250 |
| BD14120-1I*-TS | 131 | 50 3/4 | 7 3/8 | 14 3/4 | 48 5/8 | 8 3/4 | 2 @ 350 |
| BD14144-1I*-TS | 155 | 50 3/4 | 13 3/8 | 26 3/4 | 48 5/8 | 14 3/4 | 2 @ 400 |
| BD14168-1I*-TS | 179 | 50 3/4 | - | 12 1/2 | 48 5/8 | 2 1/4 | 3 @ 350 |
| BD14192-1I*-TS | 203 | 50 3/4 | 8 11/24 | 16 11/12 | 48 5/8 | 9 5/6 | 3 @ 400 |

- The Air Curtain is designed to comply with the National Electric Code (NEC) and the Furnaces are ETL verified to be 83% efficient with 3/8" overhead mounting hardware for overhead mounting.
- 7/8" mounting holes (4) provided, (2) on each end of air curtain and 5/8" mounting holes (2) provided, (1) on each end of transition assembly.
- Cabinet has sufficient strength for fastening from overhead on both ends without intermediate support. Furnace must be mounted at least 2" away from the transition. Transition pieces are provided with pilot holes for easy field assembly and hardware is included.
- Factory assembled, powder coated Transition shipped loose for field installation. Units 10' and longer, use (2) transitions side by side.
- Unit is to be installed such that air flow is unobstructed. Air discharge nozzle containing adjustable air directional vanes with 40° sweep front to back.
- Furnaces with impellers have positive pressure, 20 gauge aluminized tubular heat exchanger with in-shot burner technology, power vented exhaust (horizontal or vertical), single stage gas valve, direct spark ignition and certified for Category I and III venting.
- Circuit protection as per NEC by others.
- Optional motor control panel and door limit switch are field installed and/or wired by others. The door limit switch is to be mounted such that the air curtain turns on as door begins to open. To prevent unit damage, the mounting brackets must be installed such that the bottom of the air curtain is not below the door header.

BD14 (Belt Drive 14) Series

Indirect Gas Fired

Model Lengths 96" – 192"



atmosphere is everything

14716 S. BROADWAY, GARDENA, CA 90248 • Ph: (310) 532-1555 Fax: (310) 532-3030 • www.marsair.com
© Copyright Mars Air Systems, LLC 2014

Indirect Gas Fired Data Sheet

Applications: Environmental Separation = Max Height 16' / Insect Control = Max Height 14'

| BD14 (WindGuard) | Mechanical Data | | | | | | | Lab Data | |
|------------------|--------------------|-------------|------------|-------------|------------|----------------------|----------------------|--------------------|------------------|
| Model Number | Nozzle Length (in) | Length (in) | Depth (in) | Height (in) | Motor (hp) | Total Weight** (lbs) | Furnace Weight (lbs) | Max Velocity (fpm) | Max Volume (cfm) |
| BD1496-1I*-TS | 96 | 107 | 82 1/2 | 33 | 5 | 1098 | 2 @ 211 | 4500 | 11700 |
| BD14120-1I*-TS | 120 | 131 | 82 1/2 | 33 | 5 | 1435 | 2 @ 321 | 4500 | 14650 |
| BD14144-1I*-TS | 144 | 155 | 82 1/2 | 33 | 7 1/2 | 1580 | 2 @ 335 | 4500 | 17600 |
| BD14168-1I*-TS | 168 | 179 | 82 1/2 | 33 | 7 1/2 | 1990 | 3 @ 321 | 4500 | 20500 |
| BD14192-1I*-TS | 192 | 203 | 82 1/2 | 33 | 10 | 2149 | 3 @ 335 | 4500 | 23450 |

* - Use corresponding letters in "Electrical Data" columns to complete the model numbers.

** - Total Weight includes air curtain, transition, and furnace weights

Note: Data above is for 60 Hz, 17% reduction in the performance data with 50 Hz.

Features:

Air Curtain and Transition

- ❖ 5 to 10 HP continuous duty premium efficiency industrial TEFC motors
- ❖ Air curtain is a self-contained one-piece heavy gauge corrosion proof paint lock metal design
- ❖ Top mounting holes provided (3/4")
- ❖ Cabinet has sufficient strength for fastening from overhead on both ends without intermediate support
- ❖ Adjustable air directional nozzle with 40° sweep front to back
- ❖ Transition is shipped fully assembled and fastened to unit (overhead support required)
- ❖ Standard color is Titanium Silver
- ❖ Rust preventative electrostatic polyurethane powder coating
- ❖ 12-month parts warranty
- ❖ Freight Not Included (FOB Factory)
- ❖ Proudly Made in the USA

Indirect Gas Fired Furnaces

- ❖ ETL verified to be 83% efficient
- ❖ In-shot burner technology
- ❖ Aluminized tubular heat exchanger (20 gauge)
- ❖ Positive pressure 120V impellers (separate 120V, 1Ø power required)
- ❖ Power vented exhaust
- ❖ Single stage gas valve
- ❖ Standard direct spark ignition
- ❖ Certified for Category I and III Venting
- ❖ Natural gas
- ❖ Factory test fired
- ❖ Overhead mounting hardware provided (2 per furnace)

Mars Recommended Accessories (see submittals for additional details):

- ❖ Door limit switches
 - 99-125, Industrial surface-mounted door limit switch
- ❖ Controllers
 - MCP*-†‡, Motor Control Panel, 24V control voltage (* = HP Code, † = # of Motors, ‡ = Voltage Code)
Note: possible HP Codes = E (5 HP), G (7½ HP), H (10 HP)
 - MCP-TD, Adjustable time delay, 1sec-100hr (panel required)
- ❖ IDF-2STG, Two-stage heat exchanger
- ❖ IDF-SS, 409 stainless steel heat exchanger
- ❖ IDF-MOD-RS, Electronic modulating gas valve for room sensor (0-10VDC/4-20mA control voltage by others)

Sound Levels: (measured at 10' in an open field)

5 HP Motor Unit = 73 dBA, 7 ½ HP Motor Unit = 74 dBA, 10 HP Motor Unit = 75 dBA

Indirect Gas Fired Data

| Model Number | # of Furnaces | Input MBH per Furnace | Total Output MBH | Temp Rise (°F) | Flue Size | Natural Gas (NPT) CONN |
|----------------|---------------|-----------------------|------------------|----------------|-----------|------------------------|
| BD1496-1I*-TS | 2 | 250 | 415 | 33 | 5" Rnd | 1/2" |
| BD14120-1I*-TS | 2 | 350 | 581 | 37 | 6" Rnd | 3/4" |
| BD14144-1I*-TS | 2 | 400 | 664 | 35 | 6" Rnd | 3/4" |
| BD14168-1I*-TS | 3 | 350 | 872 | 39 | 6" Rnd | 3/4" |
| BD14192-1I*-TS | 3 | 400 | 996 | 39 | 6" Rnd | 3/4" |

* - Use corresponding letters in "Electrical Data" columns to complete the model numbers.

Note: Gas pressure required min/max in ("wc)(kPa): Natural Gas (3.5/14)(0.9/3.5) and LP (10/14)(2.5/3.5)

| Electrical Data (FLA) | Unit Voltage (Voltage Code) | | | Furnace |
|-----------------------|-----------------------------|----------|----------|---------|
| | 208/230v (G) | 460v (H) | 575v (I) | 115V |
| BD1496-1I*-TS | 14.2/13.0 | 6.5 | 5.3 | 16.0 |
| BD14120-1I*-TS | 14.2/14.0 | 6.5 | 5.3 | 27.0 |
| BD14144-1I*-TS | 21.6/20.0 | 10.0 | 8.9 | 27.0 |
| BD14168-1I*-TS | 21.6/20.0 | 10.0 | 8.9 | 40.5 |
| BD14192-1I*-TS | 28.0/26.0 | 13.0 | 10.3 | 40.5 |

* - Use corresponding letters in "Electrical Data" columns to complete the model numbers.


Alternate voltage codes with FLA (Full Load Amp) data:

380-415V/3Ø/50Hz (W) - 6.5A per motor (5HP), 8.3A per motor (7½HP), 11.5A per motor (10HP)

Note: For ampacity, multiply FLA X 1.25


EXAMPLE

BD14 144 - 1 I H - TS

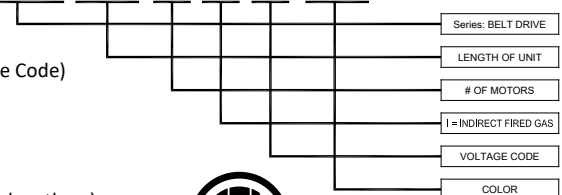

Intertek
Furnace Only


Wiring Diagram
for
1 Motor, 2 Furnace
Indirect Fired Gas Air Curtain

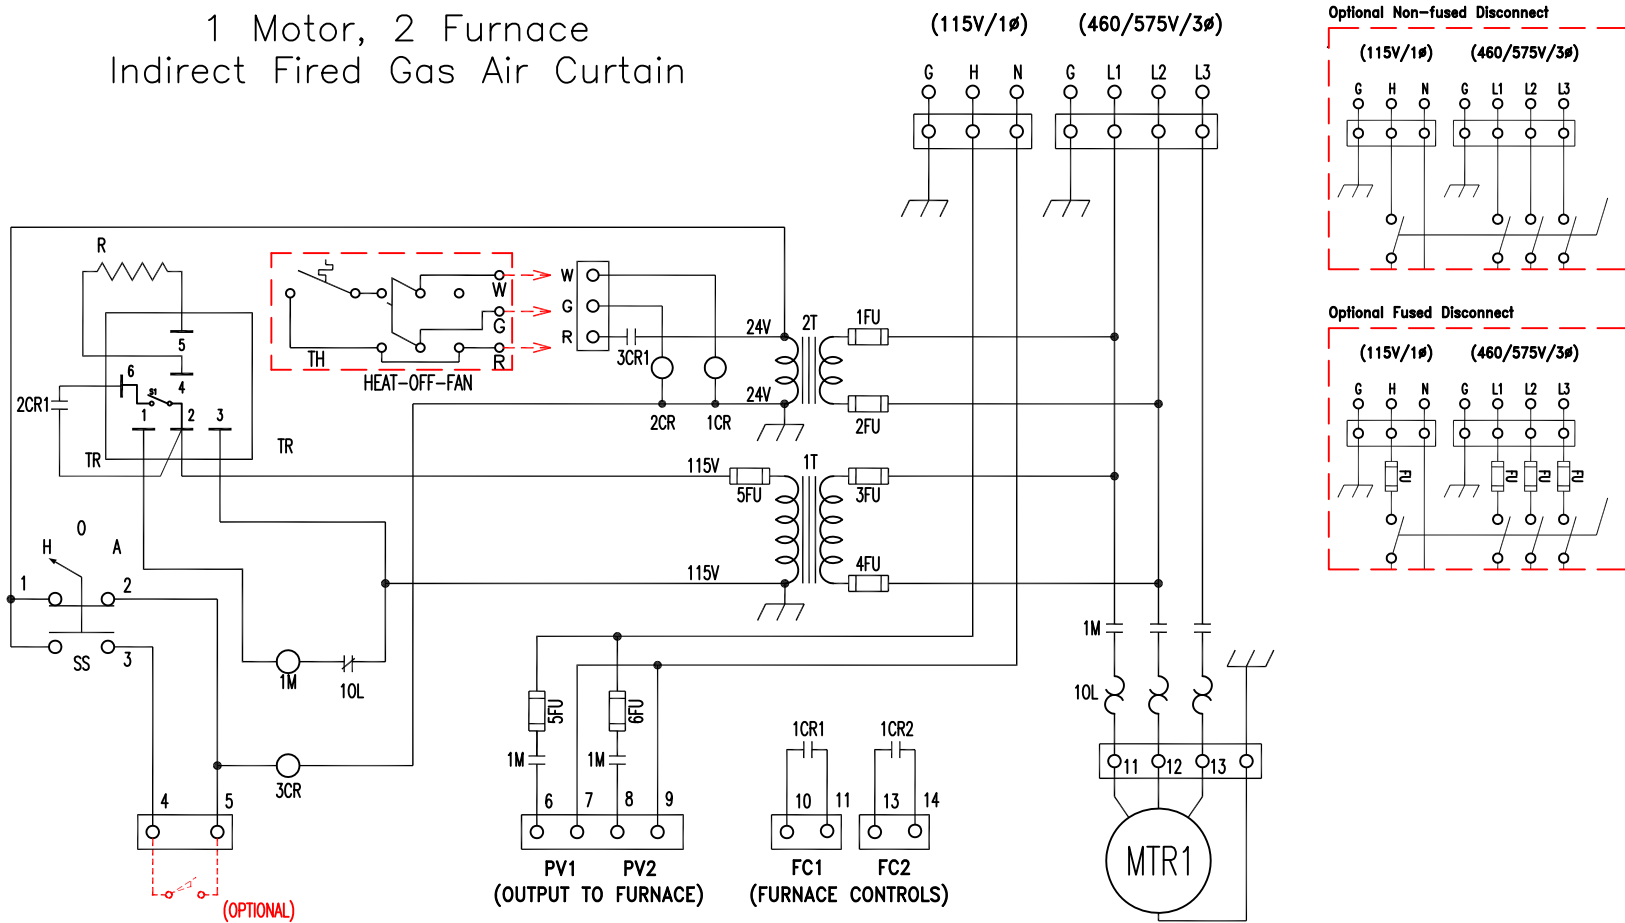

14716 S. Broadway • Gardena, CA 90248 • USA
TEL:(310) 532-1555 • (800) 421-1266 • FAX:(310) 324-3030
Web Site: www.marsair.com • E-mail: info@marsair.com

| | | | |
|---------------------------------------------------------------|--------------------------|-------------------|----------|
| PROJECT | DATE 08/30/16 | PAGE | STANDARD |
| TITLE 1 Motor, 2 Furnace Indirect Fired Gas Wiring Diagram | REV. NO. 1 | MODEL NO. | |
| COMMENTS | FILE NAME MCPH-1IG-2F | DRAWING NO. | |
| | OPTIONS/ITEMS | DRAWN BY FRC | |
| | | CHECKED BY FRC | |

Wiring Diagram
for
1 Motor, 3 Furnace
Indirect Fired Gas Air Curtain
With Time Delay

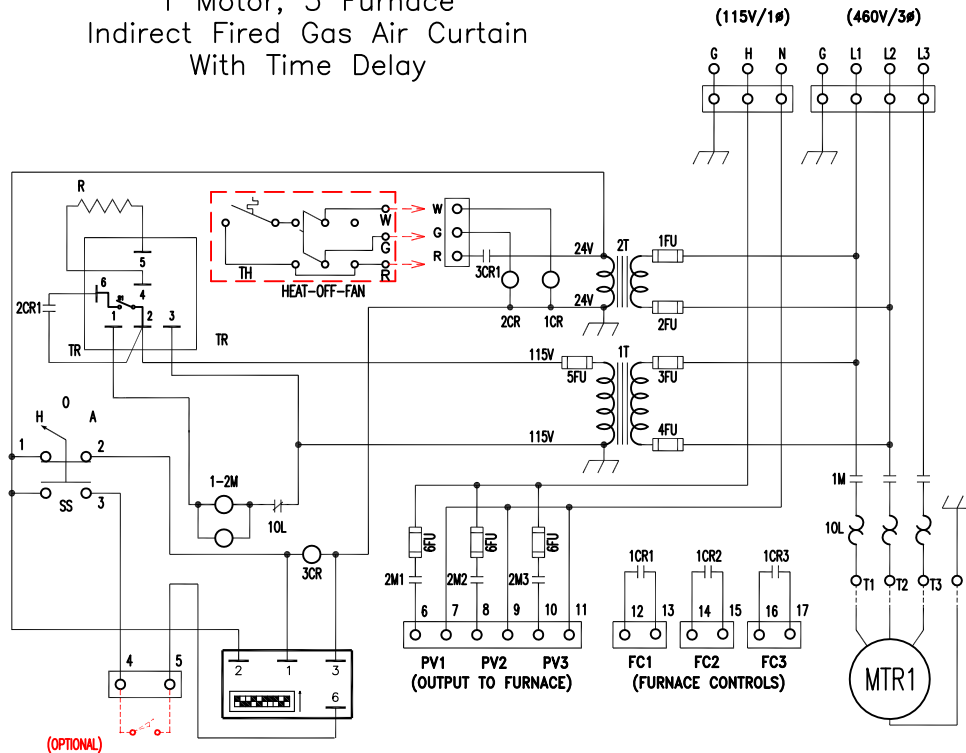

14716 S. Broadway • Gardena, CA 90248 • USA
TEL: (310) 532-1555 • (800) 421-1266 • FAX: (310) 324-3030
Web Site: www.marsair.com • E-mail: info@marsair.com

| | | | |
|---------------------------------------------------------------------|-----------------------------|------|------------------|
| PROJECT | DATE 2/15/17 | PAGE | STANDARD |
| TITLE 1 Motor, 3 Furnace Indirect Fired Gas Wiring Diagram w/ TD | REV. NO. 1 | | MODEL NO. |
| COMMENTS | FILE NAME MCPI-1IH-3F-TD | | DRAWING NO. |
| | OPTIONS/ITEMS | | DRAWN BY BH |
| | | | CHECKED BY NT |

Thermostats



Line voltage to low voltage Models

atmosphere is everything

14716 S. BROADWAY, GARDENA, CA 90248 • Ph: (310)532-1555 Fax: (310)-532-3030 • www.marsair.com
© Copyright Mars Air Systems, LLC 2014

Thermostats

| Thermostat Part # | Description | Applicable Air Curtain Series |
|-------------------|--------------------------------------------------------------------------------|------------------------------------------------|
| 99-063 | Thermostat, 801, Line Voltage, Up to 250V, Analog, Single Stage, Single Pole | LPV2, WM/BD Electric & All Hot Water / Steam |
| 99-064 | Thermostat, 802, Line Voltage, Up to 250V, Analog, Two Stage, Double Pole | LPV2 Electric & All Hot Water / Steam |
| 99-264 | Thermostat, 9200H, 24 Volt, Analog, Single Pole, R.G.W.Y.B.O. | Elec STD2, HV2, EP2, PH & All Gas Fired |
| 99-277 | Thermostat, IC20-101, 24 Volt, Analog, Single Pole, R.W. | LPV2 Electric (Low Voltage Control option) |
| 99-263 | Thermostat, RS4110, 24 Volt, Digital, Single Pole, R.G.W.Y.B.O., Battery Power | Elec STD2, HV2, EP2, PH, WM/BD & All Gas Fired |

Features:

- ❖ Allows automatic control of heated air
- ❖ Remote mounted (field installed by others)
- ❖ Temperature range from 50F to 90F
- ❖ Regulates the heat near the air curtain
- ❖ Analog Bimetal Temperature Sensing
- ❖ Thermostats are UR (UL Recognized)
- ❖ 1 year warranty

Line Voltage (99-063, 99-064)


- ❖ Standard for LPV2 Electric and All Hot Water/Steam Heated models
- ❖ Single Phase, Single Pole, 250V max
- ❖ Remote Wall Mounted by others
- ❖ Requires Junction Box (J-Box field supplied and installed)

Low voltage (99-264, 99-277, 99-263)


- ❖ Standard for STD2, HV2, EP2, PH, WM/BD Electric and all Gas Heated models
 - ❖ Low voltage (24V) control
 - ❖ Fan and Heat Control Switch
 - ❖ Remote Wall Mounted by others
- *Do not mount low voltage thermostat greater than 30ft from the air curtain. Mounting the low voltage thermostat too far from the air curtain may cause a voltage drop and cause chattering.

Options and Accessories:


- ❖ 2 Stage Line Voltage Thermostat
- ❖ Digital Programmable Low Voltage Thermostat
- ❖ Digital Low Voltage Thermostat with Battery Backup
- ❖ Factory Wired and Installed Thermostat
- ❖ Lockable clear cover

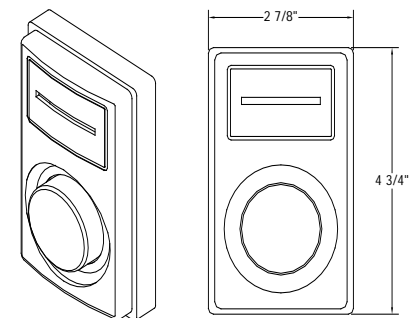


99-063 – Thermostat, 801, Line Voltage, Single Stage, Single Pole

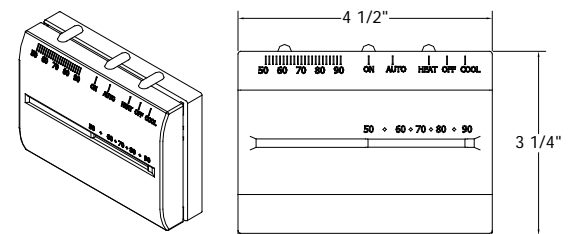


99-264 – Thermostat, 24 Volt, Analog, Single Stage, R.G.W.Y.B.O.

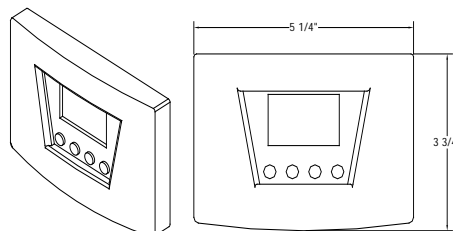

99-263 – Thermostat, 24 Volt, Digital, Single Stage., R.G.W.Y.B.O., Battery Power

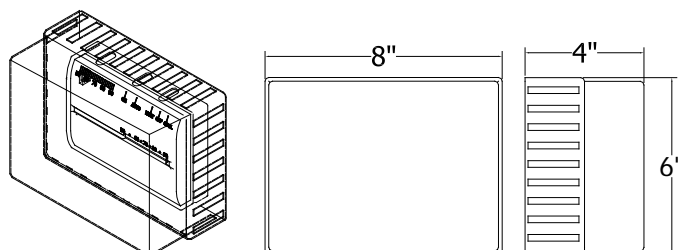

99-182 - Cover, Lockable, Clear

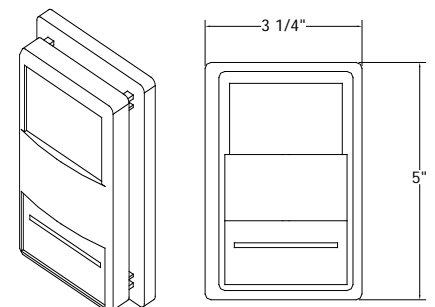

99-277 – Thermostat, 24 Volt, Single Stage, R.W.

NOTE: MARS AIR SYSTEMS, LLC reserves the right to change specifications and product design without notice. Such revisions do not entitle the buyer to corresponding changes, improvements, additions, or replacements for previously purchased equipment.

ACCESSORY INSTALLATION SUPPLEMENT

Door Limit and Magnetic Reed Switches

1. Mars door limit and magnetic reed switches are available with NEMA 1, 4X and 7 ratings. Contact the factory for additional ratings and details. (See FIG. 1 for typical single swing, hinged door type, door limit switch installation)

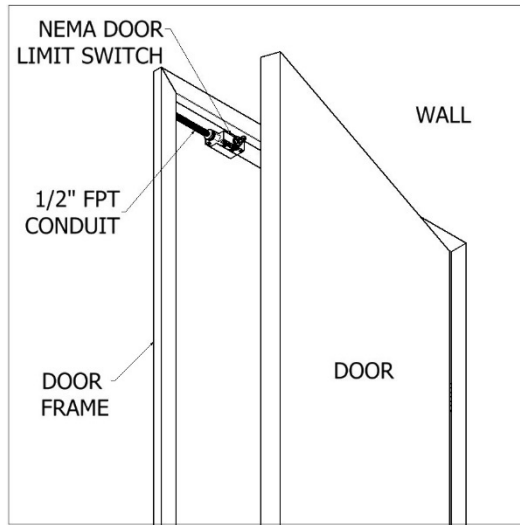


FIG. 1

2. Use light gauge materials when field fabricating brackets to activate and deactivate the door limit switch(es). (FIG. 2) Figure 2 also shows the typical installation of the combination plunger/roller type NEMA 1 door limit switch, for all non-hinged style doors.

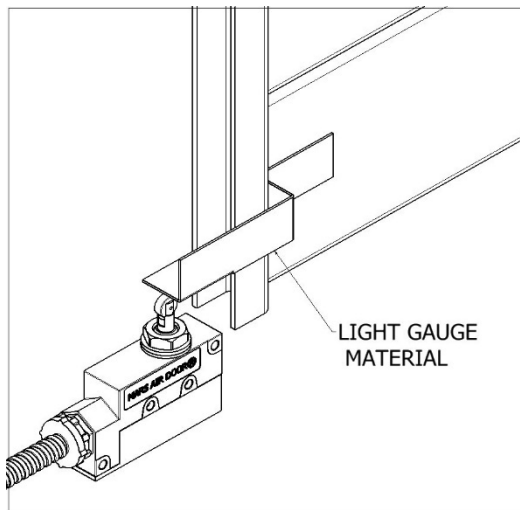


FIG. 2

3. All wiring must be per local and NEC (National Electric Code) codes.
4. Panels or controllers may be required. Refer to wiring diagram inside the control panel box.

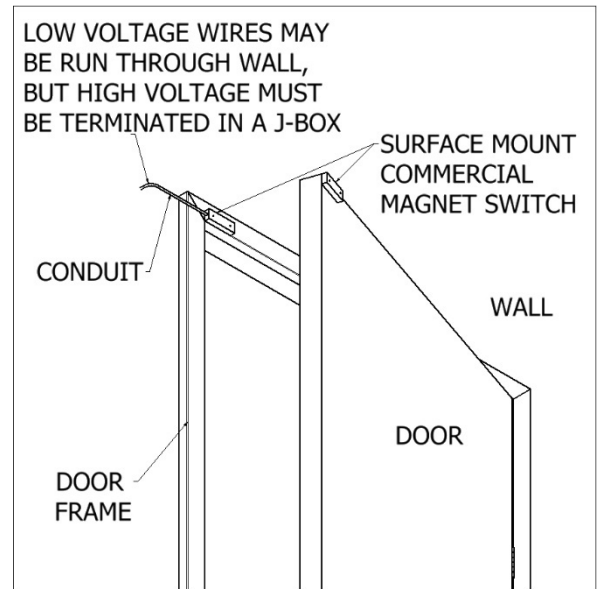


FIG. 3

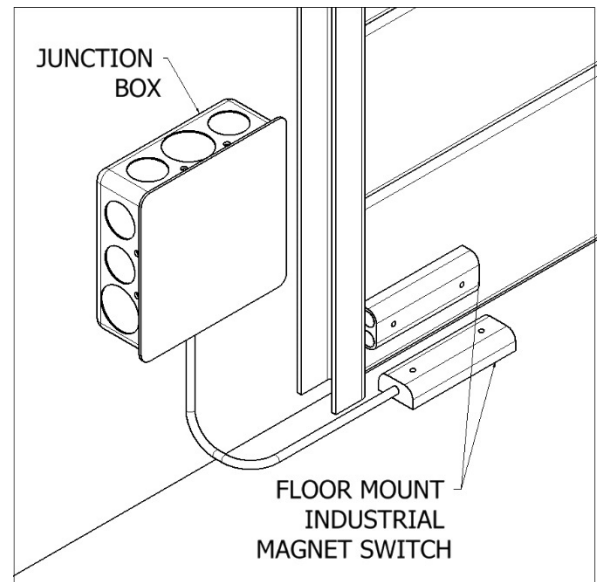


FIG. 4

atmosphere is everything

Bracket Installation

1. Side Extension Plates: For doorways wider than the air curtain, use combination of Side Extension Plates and Adjustable Mounting Brackets. (FIG. 5)

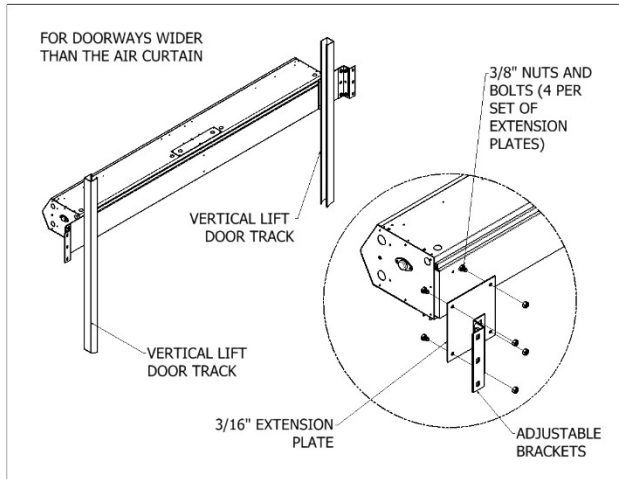


FIG. 5 (LPV SHOWN)

2. Adjustable Mounting Brackets: For installation of air curtain over drum-style roll-up door, use Extended Wall Mounting Brackets. (FIG. 6)

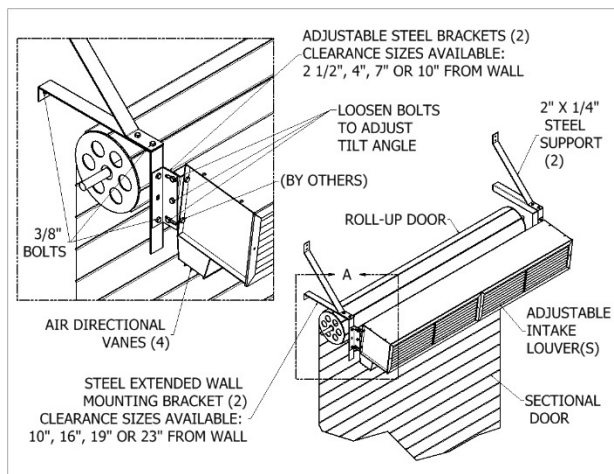


FIG. 6 (STD SHOWN)

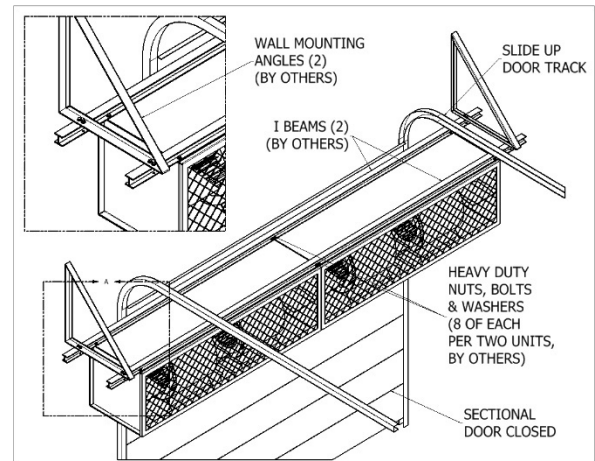


FIG. 7 (WMI/WMH SHOWN)

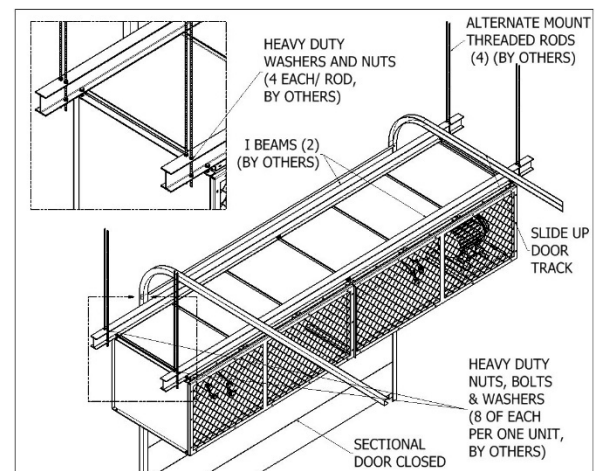


FIG. 8 (BD SHOWN)

3. Extended Wall Mounting: For Tandem Mounting of air curtain over sectional style door, use either wall mounting angle brackets or threaded rods.
4. Top Mounting Brackets: For overhead installation of units, use in conjunction with the threaded holes provided on top of unit.

Note: Angle brackets, threaded rods and I Beams are provided by others. (FIGS. 7 & 8) All optional brackets are not available for WMI/WMH and BD Series.



atmosphere is everything

Document No: BD-IOM
Date: 08/25/20

WINDGUARD BELT DRIVE (BD) INDUSTRIAL SERIES

Installation, Operation and Maintenance Manual

Please read and save these instructions. Read carefully before attempting to assemble, install, operate, or maintain the product described. Protect yourself and others by observing all safety information. Failure to comply with these instructions could result in personal injury and/or property damage. Retain these instructions for future reference.

OVERVIEW

Mars Air Curtains are designed to cover door openings, providing both temperature control/environmental separation and flying insect control when the building's doors are opened. Typical installation heights are:

BD-14 Series


(Environmental Separation up 16' and Flying Insect Control 14'), BD-18 Series (Environmental Separation up 20' and Flying Insect Control 18'), BD-22 Series (Environmental Separation up 24' and Flying Insect Control 22'), BD-26 Series (Environmental Separation up 28' and Flying Insect Control 26') and BD-30 Series (Environmental Separation up 32' and Flying Insect Control 30'). The units are typically overhead mounted horizontally above the door opening. They can also be vertically mounted alongside the opening. Heated units must be mounted on the inside or the protected side of the opening. The motors used in the BD Series range from 5 HP to 30 HP (see submittal for details).

All the BD Series come standard with an expanded metal air intake grille(s). The BD Series can be configured with Flat Bank or V-Bank Sections, as options.



WARNING

When servicing the product, motor may be hot enough to cause pain or injury. Allow motor to cool before servicing.

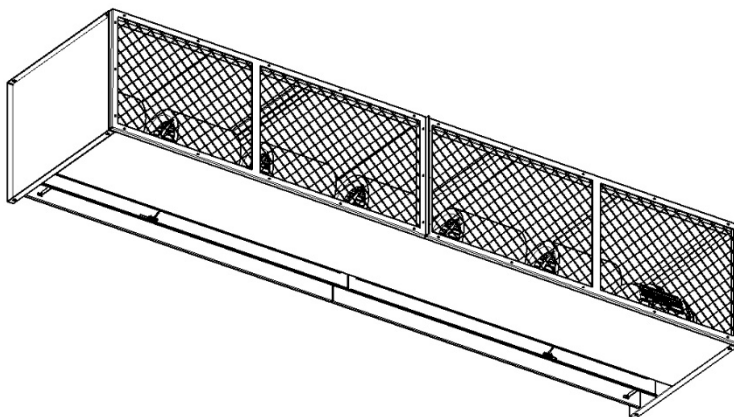

GENERAL SAFETY INFORMATION

Use this product only in the manner intended by the manufacturer. If you have any questions, contact the manufacturer. Only qualified personnel should install this product. Installing personnel should have a clear understanding of these instructions

and should be aware of general safety precautions. Improper installation can result in electric shock, possible injury due to coming in contact with



WARNING

To reduce the risk of fire, electric shock, or injury to persons, observe the following.

- Always disconnect, lock and tag power source before installing or servicing product.
- Installation work or electrical wiring must be done by qualified person(s) in accordance with all applicable codes and standards, including fire-rated construction.
- The combustion airflow needed for safe operation of fuel burning equipment in the area may be affected by the product's operation. Follow the heating equipment manufacturer's guideline and safety standards, such as those published by the National Fire Protection Agency (NFPA), the American Society of Heating, Refrigeration and Air Conditioning Engineers (ASHRAE) and local code authorities.
- When cutting or drilling into a wall or ceiling, be careful not to damage electrical wiring and other hidden utilities.

moving parts, as well as other potential hazards.



WARNING

Precaution should be taken in explosive atmospheres.

RECEIVING AND INSPECTION

Upon receiving the product, check to make sure all items are accounted for by referencing the Bill of Lading to ensure all items were received. Inspect each carton for shipping damage before accepting delivery. Notify the freight carrier if any damage is noticed. The carrier will make notification on the delivery receipt acknowledging any damage to the product. All damage should be noted on all copies of the Bill of Lading which is countersigned by the delivering carrier. A Carrier Inspection Report should be filled out by the carrier upon arrival damaged upon arrival, file a claim immediately with the carrier. Any physical damage to the unit after acceptance is not the responsibility of Mars Air Systems.

UNPACKING

Verify that all parts, components and accessories, and the correct quantities of each have been received. If any items are missing, report shortages to Mars Air Systems directly to arrange for obtaining the missing items. Again, verify quantities received against those on the Bill of Lading only, as multiple shipments may be involved.

INSTALLATION

Typical Mounting – Wall or Ceiling Mounted Horizontally Above the Door Opening

1. Overhead installation is recommended to prevent the possibility of the unit falling if the wall to which the unit is mounted is hit by a truck or material handling device. If, however, wall or bracket mounting is preferred, additional holes may be drilled in the side panels of the housing.

Note: Bracket/Support mounting is not generally recommended for Air Curtains equipped with steam or hot water coils. Overhead installation using threaded rods with independent suspension of coils is recommended.

2. Center the unit over the opening. The air curtain shall be equal to or greater than the width of the opening.
3. Four pre-punched 1/2" mounting holes on the top of the unit are provided for your convenience. These holes must be utilized to secure the product overhead. All hardware is field provided by others.

4. Mount the product such that the discharge is 1" above the opening and all obstacles. (FIG. 1)

Note: If the product is installed higher than the recommended 1" above the opening, then it must be moved 3/8" away from the wall for every 1" that it is moved up. Any void between the wall and the product must be sealed, by others, to optimize performance.

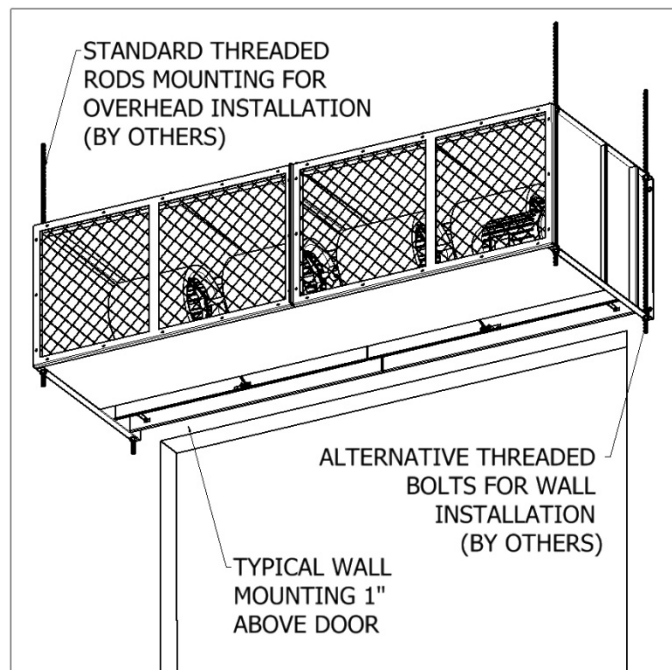


FIG. 1

5. Use four (4) threaded rods for overhead installation or four (4) threaded bolts for wall installation. All hardware is field provided by others. (FIG. 1)
6. If applicable, for tandem installation or products mounted side by side, allow no more than 6" between the two products. For overhead installation using threaded rods, the products may require a beam, by others, to span the full distance of the mounting length. (Reference **Accessory Installation Supplement**)
7. All wires must be connected to the external junction box(s) of the unit.
8. The unit must be wired per NEC and local codes.

Electrical Field Wiring

The unit and any optional accessories must be wired with the proper voltage to the junction box per the wiring diagram. (FIG. 2, unheated products only)

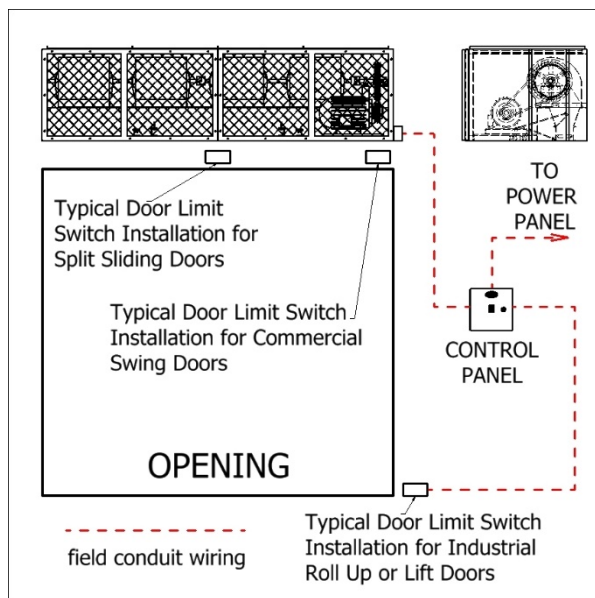


FIG. 2

NOTE

For accessory installation, reference **Accessory Installation Supplement**.

For heated products, reference **Heated Products Supplement**.

START-UP

This product has been assembled and tested at the factory prior to shipping. The following procedures should be performed to assure its performance. Before continuing with the start-up, it is important to recognize the safety controls furnished with the unit.



WARNING

Prevent hazard of electrical shock. More than one disconnect switch may be required to de-energize this product.



WARNING

The following items must all be completed by a qualified installer and checked off when completed

- Re-check that the product has been installed properly and is level and secure.
- Check all terminal screws are tight and field wiring is connected in accordance to National Electrical Code and wired per the enclosed wiring diagram. For electric heated models, ensure that the coils are secured and not touching each other on any metal surface.
- Verify proper voltage prior to powering the product. (See product label for reference).

- Check all field wired components "if supplied" are wired correctly.
- Check that the inlet air supply and the discharge air supply are free of obstructions.
- Check that all air filter(s) and/or air intake grille(s) are in place and installed properly, as originally shipped.
- Verify voltage to the product once more and turn power on.
- Regardless of whether the product is mounted on the inside or outside of the door opening, set the air directional vanes in the discharge nozzle slightly outward to approximately 10-15° towards the outside, or the wind load. (FIG. 3).

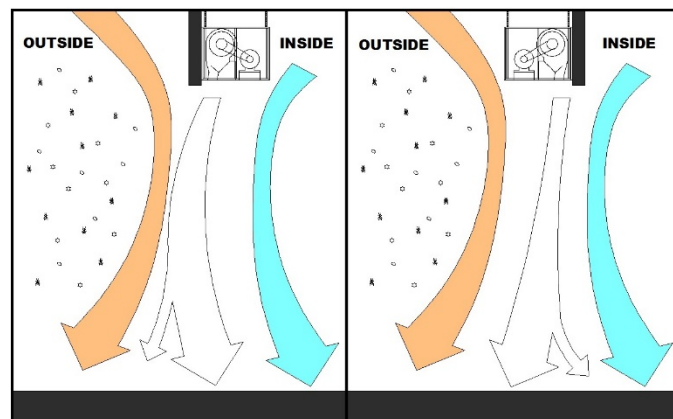


FIG. 3

- For products with control panels, turn the HOA (Hand-On-Auto) selector switch to "On" position and open the door to energize the product. For products without a control panel or an On/Off switch, open the door to energize the product.
- If heated products are installed, reference **Heated Products Supplement**.
- For three phase units, verify direction of rotation of blower wheels (note direction arrows on the blower wheel housing). Correct if needed by changing polarity of three phase power.
- VERY IMPORTANT** Using a clamp meter, measure the amperage to each motor and ensure that they do not exceed the amperage listed on the product label.
- If applicable, adjust the air intake grille(s) such that the output air stream reaches the floor. For temperature control and environmental separation applications, the air stream should reach the floor with sufficient strength to create an air seal around the door opening without creating turbulent mixing of the inside and outside air. For flying insect control applications, the air stream should reach the floor with maximum strength. If after proper installation and adjustment, the product appears to be producing too little or too much air for the application, contact the manufacturer.

MAINTENANCE



WARNING

To reduce the risk of fire, electrical shock or injury to persons, observe the following:

- A. Maintenance is to be performed only by qualified personnel who are familiar with local codes and regulations and are experienced with this type of product.
- B. Before servicing or cleaning the product switch power off at service panel and lock service panel to prevent power from being switched "ON" accidentally.

Routine maintenance is required to keep this product operating at its peak performance and efficiency. Over time, the housing, air intake grille, air intake filter, blower wheels and motor(s) will accumulate a build up of dust, debris and other residue. It is imperative to keep these components clean. Failure to do so will not only lower operational efficiency and performance, but also reduce the useful life of the product. The time between cleanings depends on the application, location and daily hours of use. On average, under normal use conditions, the product should require a thorough cleaning once every six (6) months.

To clean the product, perform the following:

1. Verify the product has been disconnected from the power source.
2. Use a damp cloth and either a warm mild soapy water solution or bio-degradable degreaser, to wipe down the exterior components of the housing.
3. To access the interior of the product, remove the air intake grille(s) and/or air intake filter(s). This is accomplished by removing the screws on the face of the air intake grille(s)/filter(s) or top access panels.
4. Thoroughly clean the air intake grille(s)/filter(s) or top access panels.
5. Thoroughly wipe down the motor, blower wheels and blower wheel housings. Be careful not to spray the motor with a water hose.
6. The motor(s) may require additional lubrication. The cartridge bearings for blowers are permanently lubricated double sealed ball bearings and do not require additional lubrication. The pillow block bearings require periodic greasing depending on use. The Zerk fittings are provided on bearing.
7. To re-install the product, reverse the procedures above.
8. Reconnect the power source to the product.
9. If you have any questions regarding the maintenance of the product, contact the manufacturer.

SPECIAL APPLICATIONS

Outdoor Installation

For outdoor unit special consideration may be required for enclosure, motor, wheel, and other components to minimize damage caused by exposure to the outdoor elements. Contact factory for special construction and costing.

Freezer and Cooler Installation

Air curtain must be mounted on the warm side for optimal performance. Variable Frequency Drive (VFD) is strongly recommended to control the air curtain air flow velocity at the floor level.

High humid areas may require de-humidifier or additional defrost cycle to minimize condensation and freezing for freezer applications. We recommend the air curtain unit to not replace doors but work in conjunction with door opening sequence cycle. Contact factory for details.

DISCLAIMER


Mars reserves the right to change specifications and product design without notice. Such revisions do not entitle the buyer to corresponding changes, improvements, additions, or replacements for previously purchased equipment.

TROUBLESHOOTING

| PROBLEM | CAUSE | SOLUTION |
|------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| NO AIR BLOWING OUT OF DISCHARGE NOZZLE | <ul style="list-style-type: none"> - No power being supplied to the unit from the electrical power source - Circuit breaker is tripped - Blown fuses on power supply - Motor overload is open or tripped - Motor contactor / relay defective (if applicable) - Failed switch | <ul style="list-style-type: none"> - Confirm power source / check if in on position - Reset circuit breaker - Replace fuses - Allow the motor to cool down; motor has auto reset internal overload; if unit is panel equipped, press reset button on overload inside panel, or replace motor overload if overload remains tripped - Check voltage to coil; check contacts to see if they are pulling in - Replace or repair limit switch |
| MOTOR IS RUNNING BUT FANS ARE NOT SPINNING | <ul style="list-style-type: none"> - Loose or broken coupling (belt drive) - Loose set screws on wheel hubs - Fan spinning inside fan housing - Broken fan hub | <ul style="list-style-type: none"> - Replace or tighten coupling - Tighten set screws on motor shaft flats - Tighten fan on shaft or replace fan - Replace fan wheels |
| ELECTRICAL CONTROLS NOT WORKING WHEN DOOR IS OPEN | <ul style="list-style-type: none"> - Switch is in off position - Door limit switch is not operating | <ul style="list-style-type: none"> - Turn unit's switch to the on position - Repair or replace door limit switch |
| UNIT WILL NOT TURN OFF | <ul style="list-style-type: none"> - Door limit switch is permanently closed or energized | <ul style="list-style-type: none"> - Position the door switch in a manner that turns off the unit when the door closes and turns on the unit when the door opens. Only light pressure required. |
| LOW AIR FLOW | <ul style="list-style-type: none"> - Discharge air vanes out of adjustment - Obstruction on intake or discharge - Power leads out of polarity - Blower motor rotating below normal speed - Fan rubbing against housing - Blower wheels clogged with dirt | <ul style="list-style-type: none"> - Adjust vanes to proper position (Refer to Start-Up Section in this manual) - Remove obstruction or move air curtain - Switch power leads to correct polarity (3 phase models only) - Apply proper voltage per unit requirement (see unit label) / Adjust adjustable motor speed knob (if applicable) - Free fan from housing - Clean and remove dirt from blower wheels |
| EXCESSIVE AIR VELOCITY AT DOOR OPENING | <ul style="list-style-type: none"> - Nozzle out of adjustment and not angled far out enough (BD only) - Air temperature too cold - Air stream pushing air outside of the building | <ul style="list-style-type: none"> - Adjust nozzle angle to outside - Add auxiliary heat to overcome wind chill - Adjust discharge angle back into building |
| AIR NOT HITTING THE FLOOR | <ul style="list-style-type: none"> - Low air velocity - Obstruction in the direction of air flow - Negative building pressure | <ul style="list-style-type: none"> - Adjust vanes to proper position or check installation height (Refer to Start-Up Section in this manual) - Remove obstruction or move air curtain (Move out 3/8" for every 1" up from the door) - Provide a make-up air system to relieve negative building pressure |
| UNEVEN AIR | <ul style="list-style-type: none"> - Shaft rotating inside fan - One motor not functioning | <ul style="list-style-type: none"> - Replace fan or tighten fan on shaft - Replace or repair motor |
| EXCESSIVE NOISE AND OR VIBRATION | <ul style="list-style-type: none"> - Loose or broken coupling (belt drive) - Loose set screws on wheel hubs - Fan spinning inside fan housing - Broken fan hub - Bearing end caps worn - Damaged blower wheel - Bearing end caps worn - Pillow block bearings make noise - Balancing clips missing | <ul style="list-style-type: none"> - Replace or tighten coupling - Tighten set screws on motor shaft flats - Tighten fan on shaft or replace fan - Replace fan wheels - Replace Bearing end caps - Replace Blower Wheel - Replace Bearing end caps - Grease Bearing - Replace Blower Wheel |

TROUBLESHOOTING MOTOR

To determine if the motor is in good operating condition, compare measured motor resistance at the motor terminals to the values shown below.

| MARS MOTOR RESTANCE READINGS | | | | | | | | | | |
|---------------------------------------------------------------------------------------------------------------|---------------|---------------------|----------|-----------------|-------|---------|-------|-----------------------------------------------|-----------------------------------------------|-----------------------------------------------|
| Single Phase Motors | | | | | | | | | | |
|  atmosphere is everything | | | | | | | | MOTOR WIRES OR TERMINAL (T) OHM READINGS | | |
| | | | | | | | | HIGH SPEED (1750) | MEDIUM SPEED (1650) | LOW SPEED (1450) |
| Applicable Air Curtain Series | Mars Part # | Manufacturer Part # | Brand | Motor Rating | HP | Voltage | Phase | Black Motor Wire & White Motor Wire | - | - |
| LPV2, LPN2 | 03-001 | 7190-1682 | Fasco | Nema 1 | 1/6 | 115 | 1 | 11.5 | - | - |
| | 03-002 | 7190-1903 | Fasco | Nema 1 | 1/6 | 115 | 1 | 8.4 | - | - |
| | 03-003 | 7190-1825 | Fasco | Nema 1 | 1/6 | 230 | 1 | 64 | - | - |
| | 03-004 | 7190-1904 | Fasco | Nema 1 | 1/6 | 230 | 1 | 44.6 | - | - |
| Applicable Air Curtain Series | Mars Part # | Manufacturer Part # | Brand | Motor Rating | HP | Voltage | Phase | White Motor Wire (T1) & Black Motor Wire (T3) | White Motor Wire (T1) & Black Motor Wire (T5) | White Motor Wire (T1) & Black Motor Wire (T2) |
| STD2, N2, PH10, QP10 | 03-010 | 34G928X169 | Baldor | Washdown (IP54) | 1/2 | 115 | 1 | 1.2 | - | - |
| | 03-010 | 34G928X169 | Baldor | Washdown (IP54) | 1/2 | 208/230 | 1 | 4.6 | - | - |
| | 03-005 | 7124-1175 | Genteq | Nema 1 | 1/2 | 115 | 1 | 2.6 | 3.8 | 5.2 |
| | 03-006 | 7124-1560 | Genteq | Nema 1 | 1/2 | 208/230 | 1 | 9.9 | 15.9 | 22.5 |
| | 03-007 | 48S17T439 | Marathon | Nema 1 | 1/2 | 277 | 1 | 7.7 | - | - |
| | 03-005 | K055PWM1736C13H | Nidec | Nema 1 | 1/2 | 115 | 1 | 2.1 | 3.7 | 5.2 |
| | 03-005 | K055PWM1736C13H | US | Nema 1 | 1/2 | 115 | 1 | 5.3 | 3.7 | 5.4 |
| | 03-006 | | US | Nema 1 | 1/2 | 208/230 | 1 | 8.7 | 18.2 | 24.2 |
| Applicable Air Curtain Series | Mars Part # | Manufacturer Part # | Brand | Motor Rating | HP | Voltage | Phase | White Motor Wire (T1) & Black Motor Wire (T2) | White Motor Wire (T1) & Black Motor Wire (T3) | - |
| HV2, NH2, PH12 | 03-021 | 35T276R025G1 | Baldor | Washdown (IP54) | 1 | 115 | 1 | 0.7 | - | - |
| | 03-015-Baldor | 35M316S174 | Baldor | Nema 1 | 1 | 115 | 1 | 0.6 | - | - |
| | 03-015-Baldor | 35M316S174 | Baldor | Nema 1 | 1 | 208/230 | 1 | 2.2 | - | - |
| | 03-021 | 35T276R025G1 | Baldor | Washdown (IP54) | 1 | 208/230 | 1 | 2.8 | - | - |
| | 03-014 | 7124-0985 | Genteq | Nema 1 | 1 | 115 | 1 | 1.6 | 2.4 | - |
| | 03-015 | 7124-1096 | Genteq | Nema 1 | 1 | 208/230 | 1 | 6.5 | 9.2 | - |
| | 03-015 | - | Nidec | Nema 1 | 1 | 208/230 | 1 | 4.3 | 6.5 | - |
| | 03-014 | K558WJZB-2362 | US | Nema 1 | 1 | 115 | 1 | 1 | 2.1 | - |
| | 03-015 | - | US | Nema 1 | 1 | 208/230 | 1 | 3.2 | 6.3 | - |
| Three Phase Motors | | | | | | | | | | |
| Applicable Air Curtain Series | Mars Part # | Manufacturer Part # | Brand | Motor Rating | HP | Voltage | Phase | LEAD WIRE OHM READINGS | | |
| | | | | | | | | Black Motor Wire (L1) & Red Motor Wire (L2) | Black Motor Wire (L1) & White Motor Wire (L3) | Red Motor Wire (L2) & White Motor Wire (L3) |
| STD2, N2, PH10, QP10 | 03-008 | P55YDHB-1527 | US | Nema 1 | 1/2 | 208-230 | 3 | 16.1 | 16.1 | 16.1 |
| | 03-008 | P55YDHB-1527 | US | Nema 1 | 1/2 | 460 | 3 | 63.6 | 63.6 | 63.6 |
| | 03-009 | 48T17T135 | Marathon | Nema 1 | 1/2 | 575 | 3 | 136 | 136 | 136 |
| HV2, NH2, PH12 | 03-017 | 56T17T5541 | Marathon | Nema 1 | 1 | 208-230 | 3 | 4.3 | 4.3 | 4.3 |
| | 03-017 | 56T17T5541 | Marathon | Nema 1 | 1 | 460 | 3 | 16.5 | 16.5 | 16.5 |
| | 03-018 | 56T17T5544 | Marathon | Nema 1 | 1 | 575 | 3 | 26.6 | 26.6 | 26.6 |
| | 03-022 | 35N127S902 | Baldor | Washdown (IP54) | 1 | 208-230 | 3 | 5.1 | 5.1 | 5.1 |
| | 03-022 | 35N127S902 | Baldor | Washdown (IP54) | 1 | 460 | 3 | 19.8 | 19.8 | 19.8 |
| EP2 | 03-026 | 165716 | Century | Nema 1 | 3 | 208-230 | 3 | 1.5 | 1.5 | 1.5 |
| | 03-026 | 165716 | Century | Nema 1 | 3 | 460 | 3 | 5.7 | 5.7 | 5.7 |
| | 03-028 | 35E92V26 | Baldor | Nema 1 | 3 | 575 | 3 | 9.2 | 9.2 | 9.2 |
| WMI | 03-110 | 36H110-2211G1 | Baldor | Nema 1 | 1,2,3 | 208-230 | 3 | 3.5 | 3.5 | 3.5 |
| | 03-110 | 36H110-2211G1 | Baldor | Nema 1 | 1,2,3 | 460 | 3 | 13.5 | 13.5 | 13.5 |
| WMH | 03-055 | 37F932W828G1 | Baldor | Nema 1 | 5 | 230 | 3 | 0.7 | 0.7 | 0.7 |
| | 03-055 | 37F932W828G1 | Baldor | Nema 1 | 5 | 460 | 3 | 2.4 | 2.4 | 2.4 |
| | 03-046 | 37F909X889G1 | Baldor | Nema 1 | 7 | 230 | 3 | 0.6 | 0.6 | 0.6 |
| | 03-046 | 37F909X889G1 | Baldor | Nema 1 | 7 | 460 | 3 | 1.6 | 1.6 | 1.6 |
| BD | 03-033 | U639A - 215TTC6027 | Marathon | Nema 1 | 10 | 208-230 | 3 | 0.4 | 0.4 | 0.4 |
| | 03-033 | U639A - 215TTC6027 | Marathon | Nema 1 | 10 | 460 | 3 | 1.2 | 1.2 | 1.2 |
| | 03-074 | GT1128A 170118.60 | Marathon | Nema 1 | 25 | 575 | 3 | 0.5 | 0.5 | 0.5 |

WARRANTY

Mars' warranty coverage, period, extent, and limitations apply to the product only. It does not apply to labor. Mars warrants that Mars product 1) Is free from defects in materials and workmanship and 2) Conforms to Mars' published specifications. The warranty period for Mars BD product is a twelve (12) month period commencing on its date of shipment. The date on customer's invoice is the date of shipment, unless Mars or your reseller informs you and Mars otherwise. Mars will provide free replacement of any part that fails as a result of a defect in material or manufacturer's workmanship. Changes in operational specification parameters that are different from those provided on the original purchase order are not covered. Mars product is inspected and tested before packaging and is shipped in working condition. The warranty for Mars product only covers free-of-charge replacement of failed parts. The warranty does not cover labor and transportation expenses that may be required to provide and to install replacement parts. Because in many instances, it is impossible to determine the cause of failure, customer may be responsible for transportation charges associated with replacement of failed part. Mars does not warrant uninterrupted or error-free operation of Mars product. Under no circumstance is Mars liable for any of the following: 1) Third-party claims against you for damages; or 2) Special, incidental, or indirect damages or for any economic consequential damages (including lost profits and savings), even if Mars, its suppliers, or its reseller is informed of their possibility. The warranty does not cover repair or exchange of Mars product resulting from misuse, accident, modification, unsuitable physical or operating environment, improper maintenance and installation by customer, or failure caused by a product for which Mars is not responsible. The warranty does not cover damages caused by mishandling during transportation. The warranty is voided by removal or alteration of Mars product or parts identification labels, by improper installation of product, and resulting non-compliance to federal, state and local codes and regulations. Additionally, Mars reserves the right to void the warranty for non-payment of invoice.

**CONTACT FACTORY FOR COMPLETE PARTS
LIST FOR ALL MODELS.**

KEEP THIS MANUAL FOR YOUR RECORDS.

Model Number: _____

Serial Number: _____

Date Purchased: _____

Dealer Purchased From: _____



atmosphere is everything

14716 S. Broadway St., Gardena, CA 90248

(310) 532-1555 • (800) 421-1266



Fax: (310) 324-3030

**Please go to our website at www.marsair.com for a
downloadable version of this document.**



XF/XC SERIES

Commercial/Light Commercial Unit Heaters

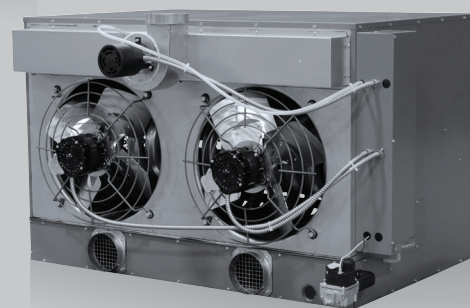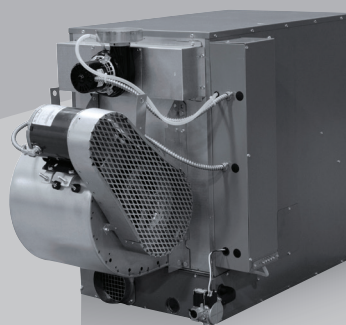

STANDARD FEATURES

- Standard or separated combustion all-in-one units
- 20-gauge aluminized steel tubular heat exchanger
- 83% thermal efficiency
- Power venter
- 20-gauge steel cabinetry with baked enamel finish
- Direct spark ignition system
- Redundant single stage gas valve
- Rear burner access for ease of service
- Individually adjustable and removable horizontal louvers
- 10-year heat exchanger, flue collector and burner warranty

OPTIONAL FEATURES

- Stainless steel heat exchanger, burners, and/or flue collector
- Two stage and various electronic modulation gas controls
- Discharge nozzles (30°, 60° & 90°)
- Combustion air inlet kits (concentric vent)
- Supply voltages: 208 & 230/1/60 and 208, 230, 460, 575/3/60



DESCRIPTION

The Sterling "XF/XC" Series Convertible Venting Type Tubular Gas-Fired Unit Heater offers a highly efficient, extremely durable alternative to the traditional clam shell design. These propeller and blower type units combine the latest tubular heat exchanger and in-shot burner technology with the quality and reliability you have come to know from Sterling. Units are available in sizes 100 to 400 MBH and have been certified by ETL as providing 83% thermal (combustion) efficiency.

CONVERTIBLE VENTING - STANDARD OR SEPARATED COMBUSTION

Notably, the Sterling "XF/XC" unit heater is designed so it can be installed in either standard or separated combustion venting configurations without requiring modification to the unit itself. Located on the rear cover panel of each unit, combustion air inlet collars are left open in a standard combustion venting configuration. When set up for separated combustion, combustion air piping is connected to the inlet collars so that the burners, spark ignitor, and flue system are enclosed within the unit, allowing the entire combustion process to remain unaffected by the atmosphere in the space where the heater is located. Separated combustion venting configurations should be used where dusty, dirty or mildly corrosive conditions exist, or where high humidity or slightly negative pressures prevail.

ADDITIONAL VENTING FLEXIBILITY

The Sterling "XF/XC" unit heater is ETL certified in accordance with categories I and III venting requirements. This certification allows units to be vented both vertically and horizontally using either single wall or double wall venting materials. Available as an accessory option, Sterling offers a Combustion Air Inlet Kit that allows for concentric venting of both combustion and exhaust air systems through one termination.

TUBULAR HEAT EXCHANGER

The Sterling tubular heat exchanger has been designed to provide maximum and uniform heat transfer. The low pressure drop associated with this design enables heated air to be evenly distributed to the conditioned space. This curved, non-welded serpentine design experiences less thermally induced stress making it highly durable for significantly longer service life. All Sterling tubular heat exchangers are constructed of heavy duty 20-gauge aluminized steel. Optional 409 stainless steel heat exchangers are also available.

DIRECT SPARK IGNITION SYSTEM & CONTROL ACCESSIBILITY

Sterling "XF/XC" units utilize a direct spark pilotless ignition of the burner, providing fast heat delivery. This highly reliable and efficient ignition system incorporates an integrated electronic control board to regulate the system sequence of operation, including an externally mounted LED indicator for simple troubleshooting. Designed with the service person in mind, ignition and fan controls are located in one centrally located control panel.

| | XF & XC | | | | | | | | |
|----------------------------------------|---------|---------|---------|---------|---------|------------|------------|------------|------------|
| Unit Size | 100 | 125 | 150 | 175 | 200 | 250 | 300 | 350 | 400 |
| PERFORMANCE DATA† | | | | | | | | | |
| Input - BTU/Hr. | 100,000 | 125,000 | 150,000 | 175,000 | 200,000 | 250,000 | 300,000 | 350,000 | 400,000 |
| Output - BTU/Hr. | 83,000 | 103,750 | 124,500 | 145,250 | 166,000 | 207,500 | 249,000 | 290,500 | 332,000 |
| Flue Size Diameter* - in | 5 | 5 | 5 | 5 | 5 | 5 | 6 | 6 | 6 |
| Gas Inlet, Natural/LP Gas - in | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 3/4 | 3/4 | 3/4 | 3/4 |
| XF PERFORMANCE/DIMENSIONAL DATA | | | | | | | | | |
| Free Air Delivery - CFM | 1,600 | 2,200 | 2,400 | 2,850 | 3,200 | 3,450 | 5,000 | 5,600 | 5,800 |
| Air Temperature Rise | 47°F | 42°F | 47°F | 46°F | 47°F | 54°F | 45°F | 47°F | 51°F |
| Full Load Amps at 120V | 6.4 | 6.9 | 6.9 | 8 | 8 | 8 | 11.6 | 13.8 | 13.8 |
| MOTOR DATA: Motor HP | 1/10 | 1/4 | 1/4 | 1/3 | 1/3 | 1/3 | 1/4 (2) | 1/3 (2) | 1/3 (2) |
| Motor Type (ODP) | SP | PSC | PSC | PSC | PSC | PSC | PSC | PSC | PSC |
| RPM | 1,050 | 1,050 | 1,050 | 1,050 | 1,050 | 1,050 | 1,050 | 1,050 | 1,050 |
| Amps @ 115V | 4.2 | 4.7 | 4.7 | 5.8 | 5.8 | 5.8 | 9.4 | 11.6 | 11.6 |
| DIMENSIONAL DATA - inches | | | | | | | | | |
| Overall Unit Height | 33-3/4 | 33-3/4 | 33-3/4 | 33-3/4 | 33-3/4 | 33-3/4 | 34 | 34 | 34 |
| Overall Unit Width | 25-1/4 | 25-1/4 | 25-1/4 | 37-1/4 | 37-1/4 | 37-1/4 | 55-1/4 | 55-1/4 | 55-1/4 |
| Overall Unit Depth | 43-1/2 | 43-1/2 | 43-1/2 | 43-1/2 | 43-1/2 | 43-1/2 | 44-3/4 | 44-3/4 | 44-3/4 |
| XC PERFORMANCE/DIMENSIONAL DATA | | | | | | | | | |
| Free Air Delivery - CFM | 1,181 | 1,476 | 1,771 | 2,067 | 2,362 | 2,953 | 3,501 | 4,134 | 4,724 |
| Air Temperature Rise | 65°F | 65°F | 65°F | 65°F | 65°F | 65°F | 65°F | 65°F | 65°F |
| Outlet Velocity - FPM | 370 | 463 | 555 | 395 | 451 | 564 | 422 | 498 | 570 |
| MOTOR DATA: Motor HP | 1/4 | 1/2 | 1/2 | 3/4 | 3/4 | 1 | 1 | 1-1/2 | 1-1/2 |
| Motor Type ODP** | SPH | SPH | SPH | SPH | SPH | Cap. Start | Cap. Start | Cap. Start | Cap. Start |
| RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| Amps @ 115V†† | 5.1 | 7.2 | 7.2 | 11.6 | 11.6 | 13 | 13 | 18.2 | 18.2 |
| DIMENSIONAL DATA - inches | | | | | | | | | |
| Overall Unit Height | 33-3/4 | 33-3/4 | 33-3/4 | 33-3/4 | 33-3/4 | 33-3/4 | 34 | 34 | 34 |
| Overall Unit Width | 25-1/4 | 25-1/4 | 25-1/4 | 37-1/4 | 37-1/4 | 37-1/4 | 55-1/4 | 55-1/4 | 55-1/4 |
| Overall Unit Depth | 49-3/4 | 49-3/8 | 49-3/8 | 56-1/8 | 56-1/8 | 56-1/8 | 53-3/8 | 56-1/8 | 56-1/8 |

† Ratings shown are for unit installations at elevations between 0 and 2,000 ft. (0 to 610m). For unit installations in U.S.A. above 2,000 ft. (610m), the unit input must be field derated 4% for each 1,000 ft. (305m) above sea level; refer to local codes, or in absence of local codes, refer to the latest edition of the National Fuel Gas Code, ANSI Standard Z223.1 (N.F.P.A. No. 54).

For installations in Canada, any reference to deration at altitudes in excess of 2,000 ft. (610m) are to be ignored. At altitudes of 2,000 ft. to 4,500 ft. (610 to 1372m), the unit must be field derated to 90% of the normal altitude rating, and be so marked in accordance with the ETL certification. See unit installation manual for field deration information.

†† See installation manual for ODP motor full load amp values at non-standard voltages.

* Flue collar is factory supplied with unit; to be field installed per included instructions.

** LEGEND: SPH = SPLIT PHASE CAP. START = CAPACITOR START ODP = OPEN DRIP PROOF



STERLING
HVAC PRODUCTS

260 North Elm St., Westfield, MA 01085
(413) 564-5540 Fax: (413) 562-5311
www.sterlinghvac.com

HEATED PRODUCTS SUPPLEMENT

NOTE

Before proceeding, refer to the units specific IOM Manual for safety, installation and start information. Verify proper voltage to the product per local and NEC codes. Ensure proper rotation for units with three phase motors.

Electrically Heated Products

Electrically heated products must be mounted on the inside of the building. Electrically heated products come standard with a thermostat (provided and shipped loose, unless ordered as factory pre-mounted) and is to be field installed at eye level within 3 feet (1 M) of the unit.

Note:

1. Electrically heated Low Profile, Phantom, Standard2, High Velocity2 and Extra Power2 units come with internally mounted controls and comes with 24V control circuit as standard option (FIG. 1) except the Low Profile series that is available with an optional 24V controls with line voltage, 115V or 208-240V controls as typical offering.
2. Wiring connection for the electrically heated Low Profile units is at the top of the housing which can be accessed by removing the top cover plate while internal terminal blocks are provided for electrically heated Phantom, Standard2, High Velocity2 and Extra Power2 units.
3. Electrically heated Wind Stopping and WindGuard units include an electric heater control panel mounted on the right-hand side, as standard. Optional motor/unit control panel available, which includes a remote 24-volt thermostat with On/Off switch with terminals provided.

The thermostat should be mounted as close to the product's discharge air flow as possible in order to best sense the discharged air temperature around the door opening. Connect proper voltage to the product per local and NEC codes.

Thermal overload protection is built into the heater coil assembly/assemblies. In the event of an overload condition, electrical power will be disconnected from the heater coil. Upon diagnosing the problem, electrical power can be re-instated to the heater coil(s) by manually resetting the thermal overload lever(s) or buttons(s) located in the unit or panel.

To operate multiple units mounted side by side, utilizing a single door switch and single thermostat, a master/slave configuration is required. (FIG. 2)

For high ampacity units, new holes can be drilled to bring in electrical wires. Use appropriate bushing for new holes to protect wire casing. High temperature silicon wires would be recommended for main supply power.

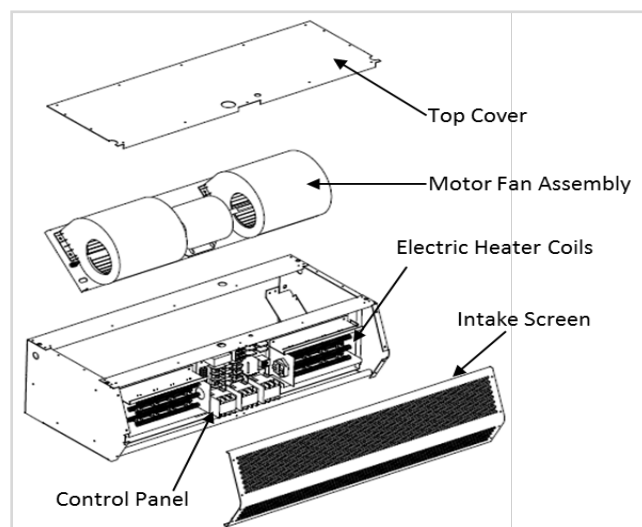


FIG. 1 (Electrically Heated STD2 unit)

Unobstructed clearance space of 18"-24" must be provided at the top of air curtain for performance and service for all heated air curtain.

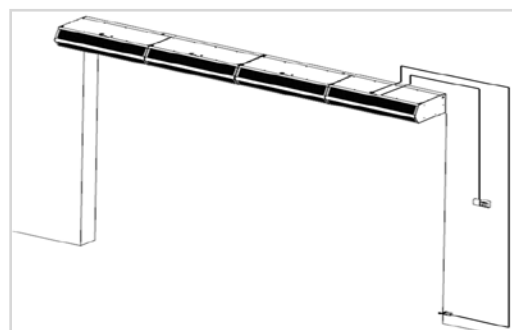


FIG. 2 (Tandem Mounted Master/Slave Units)

Steam and Hot Water Coil Heated Products

Steam/Hot Water Coil (coil) heated products must be mounted on the inside of the building. The coil(s) for Low Profile, Standard, High Velocity, Extra Power and Phantom units are shipped internally mounted to the unit. Wind Stopping and WindGuard units are shipped with coil(s) factory mounted.

Once the coil has been secured to the cabinet, access to the motor and fan is through the removable access panels located on the top of the cabinet for Standard, High Velocity, Extra Power and Phantom units.

Note: Low Profile and Wind Stopping units require the removal of the coil to access the motor and/or fans.

All piping should be done by a licensed pipe fitter and in accordance with local codes and regulations. Connect the supply and return fittings as required. All traps and valves are sized and field-installed by others. For Standard, High Velocity and Extra Power units, front intake screen must be removed to access vent plugs. Standard coil configuration is right hand supply and left-hand return. (FIGS. 3 & 4) Optional temperature controls, if ordered, are to be field installed by others.

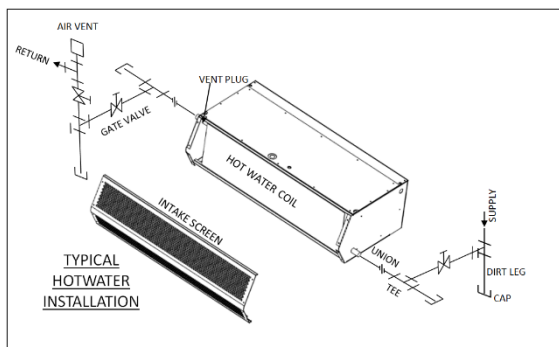


FIG. 3 (Hot Water Heated STD Unit)

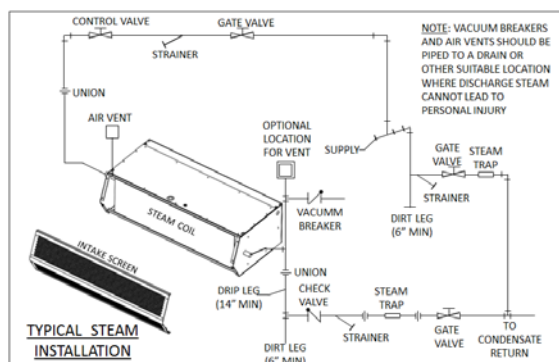


FIG. 4 (Steam Heated STD Unit)

Gas Heated Products

Gas heated products must be mounted on the inside of the building. The product consists of three major components: the air curtain, transition section(s) and indirect gas fired duct furnaces(s) (FIG 5).

The transition section(s) are shipped knocked down and are to be field assembled and installed per their supplemental instructions. (FIG. 6) (Exceptions are WMI/H and BD series, fully assembled transitions are provided).

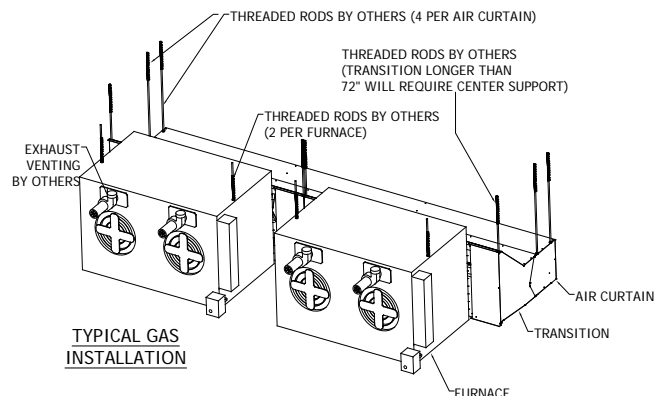



FIG. 5 (Indirect Fired Gas Heated HV Unit)

Note:

1. Assemble the transition section(s).
2. Measure the width of the transition section(s) to determine the installation location for the duct furnace(s).
3. The duct furnace(s) are typically hung from above, with threaded rods, in order to support the weight of the duct furnaces. The duct furnace(s) must be centered and equally spaced with a 2" clearance between furnaces and the transition(s).
4. Move the adjustable blank off plates to close gaps in the transition(s) and secure the flanges to the transitions.

All gas piping and duct furnace(s) exhaust venting should be done by a licensed pipe fitter and in accordance with local codes and regulations. Power vented exhaust duct runs should not exceed 100' for horizontal venting. See furnace installation manual for piping and other details.

FIG. 6 (Transition Kit Exploded View)

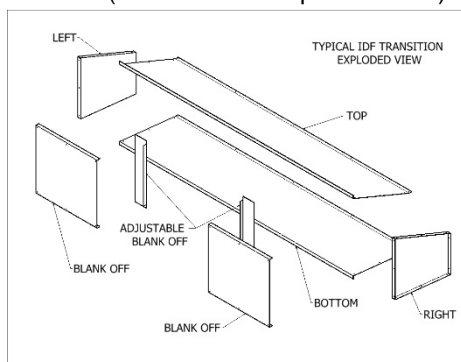

In the United States, installation must conform with local codes or, in the absence of local codes, with Installation of the National Fuel Gas Code, ANSI Z223.1-latest edition, from the American

National Standard Institute. Further reference should be made to the recommendation of your fuel supplier. In Canada, Installation must conform with local codes or, in the absence of local codes, with Installation Codes for Gas Burning Appliances and Equipment, CGA Standard CAN/CGA 1B-149. Further reference should be made to the recommendation of your fuel supplier.



atmosphere is everything

SECTION 23 34 33

AIR CURTAINS

Important Note: This specification contains hidden text appearing in red. To show or remove hidden text in MSWord, click the “File” tab or “Office” icon on the top-left corner, select “Options,” select “Display,” and check or uncheck the box marked “Hidden Text.”

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Air curtains for pedestrian entrances.
- B. Air curtains for vehicular entrances.
- C. Air curtains for large loading dock doors.

1.2 RELATED SECTIONS

- A. Section 05 50 00 – Metal Fabrications: Concealed steel support members.
- B. Section 06 10 00 – Rough Carpentry.
- C. Section 05 41 00 – Structural Metal Studs.
- D. Section 07 62 00 – Sheet metal flashing.
- E. Section 07 92 00 – Joint Sealants.
- F. Section 08 10 00 – Metal Doors and Frames.
- G. Section 08 33 00 – Overhead Coiling Doors.
- H. Section 08 42 00 – Entrance Doors.
- I. Section 22 10 00 – Plumbing Piping.
- J. Section 23 21 00 – Hydronic Piping: Hot water heating piping to units.

- K. Section 23 22 13 – Steam and Condensate Piping: Steam heating piping to units.
- L. Section 26 05 00 – Equipment Wiring: Connections to building power distribution.

1.3 REFERENCES

- A. ASTM A240 / A240M -10 – Standard Specification for Chromium and Chromium.
- B. ASTM A879 / A879M -06 – Standard Specification for Steel Sheet, Zinc Coated by the Electrolytic Process for Application Requiring Designation of the Coating Mass on Each Surface.
- C. ASTM A653 / A653M -09a – Standard Specification for Steel Sheet, Zinc Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
- D. AHRI 410-2001 – Standard for Forced-Circulation Air-cooling and Air-Heating Coils.
- E. CRN – Canadian Registration Number Coil.
- F. ANSI Z223-NFPA 54 – National Fuel Gas Code
- G. CAN/CGA B149.1 Installation Codes for Natural Gas Burning Appliances and Equipment.
- H. Electrical components UL/CUL listed.
- I. NEC – National Electric Code.
- J. U.S. Green Building Council, LEED Building Design and Construction (BD+C) Version 4.0 Rating System. (LEED v4.0).

1.4 SUBMITTALS

- A. Submit under provisions of Section 01 33 00.
- B. Product Data: Manufacturer's data sheets on each product to be used, including:
 - 1. Preparation instructions and recommendations.
 - 2. Storage and handling requirements and recommendations.
 - 3. Installation methods.
- C. Shop Drawings: Include plans, elevations, sections, and details, indicating dimensions, tolerances, materials, fasteners, hardware, finish, piping, electrical wiring diagrams, options, and accessories.
- D. LEED Submittals: Provide documentation of how the requirements of Credit will be met:
 - 1. List of proposed materials with recycled content. Indicate post-consumer recycled content and pre-consumer recycled content for each product having recycled content.

- 2. Product data and certification letter indicating percentages by weight of post-consumer and pre-consumer recycled content for products having recycled content.
- E. Selection Samples: For each finish product specified, two complete sets of color chips representing manufacturer's full range of available colors and patterns.
- F. Verification Samples: For each finish product specified, two samples, minimum size 6.25 inches (160 mm) square, representing actual product, color, and patterns.
- G. Manufacturer's Certificates: Certify products meet or exceed specified requirements.
- H. Operation and Maintenance Manual: Submit manufacturer's operation and maintenance manual, including operation, maintenance, adjustment, and cleaning instructions, troubleshooting guide, parts list, and electrical wiring diagrams.

1.5 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Minimum ten years documented experience producing the products specified in this Section
- B. Installer Qualifications: Minimum five years documented experience installing products specified in this Section

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Store products in manufacturer's unopened packaging until ready for installation.
- B. Store in a dry, heated storage area until installation of products.
- C. Protect materials and finish from damage during handling and installation.

1.7 SEQUENCING

- A. Ensure that locating templates and other information required for installation of products of this section are furnished to affected trades in time to prevent interruption of construction progress.
- B. Coordinate the installation of wiring and control switches for air curtains with the openings and the hardware provided for such openings.
- C. Install after doors, walls, ceilings, and other adjacent surfaces are finished and painted.

1.8 WARRANTY

- A. Standard one-year limited parts warranty for unheated units against defects in workmanship and material.

- B. Standard one-year limited parts warranty for heated units against defects in workmanship and materials.

PART 2 PRODUCTS

2.1 MANUFACTURER

- A. Acceptable Manufacturer: Mars Air Systems, LLC; 14716 South Broadway St., Gardena, CA 90248. Tel: (310) 532-1555 or (800) 421-1266. Fax: (310) 324-3030. Email: info@marsair.com. Web: www.marsair.com.
- B. Delete one of the following two paragraphs: coordinate with requirements of Division 1 section on product options and substitutions.
- C. Requests for substitutions will be considered in accordance with provisions of Section 01 33 00.

2.2 AIR CURTAIN ASSEMBLIES

- A. Motor Fan Assembly: Design for easy removal, assembly, repair, and maintenance.
 - 1. Motor: Totally enclosed fan cooled (TEFC) motor with sealed lifetime pre-lubricated ball bearings.
 - a. Wired for single speed operation.
 - b. Provide wash down type motors, NEC IP-54 for the locations indicated.
 - c. Provide explosion proof type motors, NEC Class 1, Division 1, Group D for the locations indicated.
 - d. Electrical Characteristics: 208/230V AC, three-phase; 14.2/13.0 Amp full load per motor for units up to 120 inches wide.
 - e. Electrical Characteristics: 208/230V AC, three-phase; 21.6/20.0 Amp full load per motor for units 144 inches to 168 inches wide.
 - f. Electrical Characteristics: 208/230V AC, three-phase; 28.0/26.0 Amp full load per motor for units 192 inches wide.
 - g. Electrical Characteristics: 460V AC, three-phase; 6.5 Amp full load per motor for units up to 120 inches wide.
 - h. Electrical Characteristics: 460V AC, three-phase; 10.0 Amp full load per motor for units 144 inches to 168 inches wide.
 - i. Electrical Characteristics: 460V AC, three-phase; 13.0 Amp full load per motor/fan for units 192 inches wide.
 - j. Electrical Characteristics: 575V AC, three-phase; 5.3 Amp full load per motor/fan for units up to 120 inches wide.
 - k. Electrical Characteristics: 575V AC, three-phase; 8.9 Amp full load per motor for units 144 inches to 168 inches wide.
 - l. Electrical Characteristics: 575V AC, three-phase; 10.3 Amp full load per motor/fan for units 192 inches wide.
 - 2. Fans: Forward curved centrifugal type, double width, and double inlet design, directly driven to an electric motor.
 - a. Provide rigid mounted base between motor and frame.
 - b. Factory balanced blower wheel assembly statically and dynamically.

- B. Housing: Self-contained one-piece type with sufficient strength for mounting from pre-punched mounting holes at both ends to adjacent walls or ceiling without intermediate support.
1. Size:
 - a. Unheated: 36 inches deep by 28 inches high by width of
 - b. Electric Heated: 42 inches deep by 28 inches high by width of unit.
 - c. Hot Water/Steam Heated: Depth 42 inches single row and 44 inches double row by 28 inches high by width of unit plus 10 inches for manifolds.
 - d. Indirect Fired Gas Heated: 82-1/2 inches deep (including transition and furnace) by 33 inches high by width of unit.
 2. Mounting:
 - a. Unheated Inside Mount.
 - b. Heated Inside Mount.
 - c. Unheated Outside Mount.
 - d. Mount Location Indicated.
 3. Material:
 - a. Provide 10-, 12-, and 14-gauge electro or hot dipped galvanized steel sheet housing conforming to ASTM A 879 and/or ASTM A 653.
 - b. Provide type 304 stainless steel housing with brushed finish. ASTM A 240/A 240M.
 4. Air Inlet Grille and/or Filters: Provide air inlet grille and/or filters specified.
 5. Discharge: Provide integral discharge nozzle specified.
 6. Finish and Color: Provide with, no VOC, corrosion resistant polyurethane powder coated finish for sheet metal housings.
 - a. Titanium Silver.
 - b. Obsidian Black.
 - c. Pearl White.
- C. Environmental and Flying Insect Control Air Curtains: Models for Heights up to 16 feet (4877 mm) for Environmental Separation and Temperature Control and up to 14 feet (4267 mm) for Flying Insect Control.
1. Discharge Nozzle: Adjustable air foil vanes with a plus/minus 40-degree sweep front to back.
 2. Air Velocity at Nozzle:
 - a. BD 14 96-1: 107 Inch (2720 mm) Wide Units: 4500 feet/min (22.9 m/s) single 5HP motor/fan assemblies.
 - b. BD 14 120-1: 131 Inch (3329 mm) Wide Units: 4500 feet/min (22.9 m/s) single 5HP motor/fan assemblies.
 - c. BD 14 144-1: 155 Inch (3939 mm) Wide Units: 4500 feet/min (22.9 m/s) single 7-1/2HP motor/fan assemblies.
 - d. BD 14 168-1: 179 Inch (4549 mm) Wide Units: 4500 feet/min (22.9 m/s) single 7-1/2HP motor/fan assemblies.
 - e. BD 14 192-1: 203 Inch (5159 mm) Wide Units: 4500 feet/min (22.9 m/s) single 10HP motor/fan assemblies.
 3. Air Speed at Floor: Minimum of 400 fpm (2 m/s) at 3 feet (914 mm) from the floor.
 4. Air Inlet Grille and Filters:

- a. Location: Front.
 - b. Type: Fixed air intake grille.
 - 1) Expanded Metal: 85% open area.
 - c. Type: Filter Only as follows:
 - 1) Filter: Flat bank 2-inch, disposable.
 - 2) Filter: V-bank 2-inch disposable.
 - 3) Filter: V-bank 2-inch aluminum washable.
5. Sound Pressure Level At 10 feet (3 m) From Nozzle:
- a. Single Motor/Fan, 5HP Units: 73 dBA.
 - b. Single Motor/Fan, 7-1/2HP Units: 74 dBA.
 - c. Single Motor/Fan, 10HP Units: 75 dBA.

2.3 COMPONENTS

- A. Electric Heaters: Provide complete with motor control panel factory mounted to air curtain housing, and thermostat to be field installed.
 - 1. Temperature limit controller.
 - 2. Heating Coils: UL approved. Factory mounted on the intake side of the air curtain cabinet.
- B. Steam Heaters: Provide finned tube steam coils for field mounting on air intake side of the air curtain cabinet with opposite end connections.
 - 1. Output: Air curtain manufacturer's standard, one-row coils.
 - 2. Output: Air curtain manufacturer's standard, two-row coils.
 - 3. Coils: Certified in accordance with AHRI 410.
 - 4. Connections: Opposite end, horizontal.
 - 5. Connections: Same end, right hand, horizontal.
 - 6. Connections: Same end, left hand, horizontal.
 - 7. Connections: Opposite end, vertical.
 - 8. Connections: Same end, right hand, vertical.
 - 9. Connections: Same end, left hand, vertical.
 - 10. Casing: One-piece unpainted galvanized steel, bolted to air curtain housing.
- C. Hot Water Heaters: Provide finned tube water coils for field mounting on air intake side of the air curtain cabinet with opposite end connections.
 - 1. Output: Air curtain manufacturer's standard, one-row coils.
 - 2. Output: Air curtain manufacturer's standard, two-row coils.
 - 3. Coils: Certified in accordance with AHRI 410.
 - 4. Connections: Opposite end, horizontal.
 - 5. Connections: Same end, right hand, horizontal.
 - 6. Connections: Same end, left hand, horizontal.
 - 7. Connections: Opposite end, vertical.
 - 8. Connections: Same end, right hand, vertical.
 - 9. Connections: Same end, left hand, vertical.
 - 10. Casing: One-piece unpainted galvanized steel, bolted to air curtain housing.
- D. Gas Heaters: Provide field mounted indirect natural gas fired, power vented duct furnace, with aluminized steel heat exchanger and die-formed stainless steel insert burners; manifolds, orifices, flame sensor, and igniter easily removable as an assembly.

1. Output: Air curtain manufacturer's standard.
 2. Complies with:
 - a. Canadian Standards Association (CSA) labeled for US and Canadian application.
 - b. ANSI Z223/NFPA 54 National Fuel Gas Code.
 - c. CAN/CGA B149.1 Installation Codes for Natural Gas Burning Appliances and Equipment.
 3. Fuel Type: Provide orifices for:
 - a. Natural gas.
 - b. LP.
 4. 24 V control voltage transformer.
 5. Combination single-stage gas control system with regulated combination redundant gas valve and intermittent spark pilot with electronic flame supervision.
 6. Limit and safety controls.
- E. Motor Control Panels for Unheated Units: Recommended for all three-phase units and single-phase units with combined motor capacities of more than 1 HP whenever a door limit switch is used to automatically start and stop the air curtain. Provide motor control panels as follows:
1. Mounting: Shipped loose to be field mounted.
 2. Mounting: Factory mounted on right hand side of air curtain housing.
 3. Mounting: Factory mounted on left hand side of air curtain housing.
 4. Electrical components UL/CUL listed.
- F. Motor Control Panels for Electric Heated Units: Recommended for all units whenever a door limit switch is used to automatically start and stop the air curtain. Thermostat is included with optional motor control panel for field installation. Provide motor control panel as follows
1. Thermostat: Wall-mounted, 24-Volt operation, with heater on/off selection.
 2. Mounting: Shipped loose to be field mounted.
 3. Mounting: Factory mounted on the inside of air curtain housing.
 4. Mounting: Factory mounted on left hand side of air curtain housing.
 5. Electrical Components UL/CUL listed.
- G. Motor Control Panels for Steam and Hot Water Heated Units: Recommended for all units whenever a door limit switch is used to automatically start and stop the air curtain. Thermostat is included with optional motor control panel for field installation. Provide motor control panel as follows:
1. Thermostat: Wall-mounted, 110-Volt operation, with heater on/off selection.
 2. Mounting: Shipped loose to be field mounted.
 3. Mounting: Factory mounted on right hand side of air curtain housing.
 4. Mounting: Factory mounted on left hand side of air curtain housing.
- H. Motor Control Panels for Gas Heated Units: Recommended for all units whenever a door limit switch is used to automatically start and stop the air curtain. Thermostat is included with optional motor control panel for field installation. Provide motor control panel as follows:
1. Thermostat: Wall-mounted, 24-Volt operation, with heater on/off selection

2. Mounting: Shipped loose to be field mounted.
 3. Mounting: Factory mounted on right hand side of air curtain housing.
 4. Mounting: Factory mounted on left hand side of air curtain housing.
 5. Motor Control Panels are UL Listed and CSA Approved
- I. Door-Activated Limit switch(s): Provide, field installed 250-Volts, 20 amps limit switch to control air curtain(s) as follows; Automatic on/off control, activates air curtain when door is opened and turns off when door is closed. Provide limit switch for direct control one 1 HP or up to two 1/2 HP single-phase motors without a separate control panel. Provide a separate control panel for three-phase motors and/or units exceeding 1 HP, 250-Volts or 20 amps controlled by a limit switch.
1. Type: Combination plunger/roller switch for swing and sliding doors.
 - a. Provide limit switches with NEMA 1 (20 amps) ratings in locations indicated.
 - b. Provide limit switches with NEMA 4X (10 amps) ratings in locations indicated.
 - c. Provide limit switches with NEMA 4X (15 amps) ratings in locations indicated.
 - d. Provide limit switches with NEMA 7 (10 amps) ratings in locations indicated.
 2. Operation for Unheated Units: Automatic on/off control, on when door is opened, off when door is closed.
 3. Operation for Gas Heated Units: Automatic on when door is opened, off after time delay period (60 seconds) after door is closed.
- J. Provide mounting hardware as required for the opening.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Verify that required utilities are in correct location and are of correct capacities for specified products.
- B. Verify openings to receive air curtains are plumb, level, square, accurately aligned, correctly located, and in tolerance.
- C. Examine surfaces to receive air curtains. If surface preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.2 INSTALLATION

- A. Install air curtains in accordance with approved shop drawings and manufacturer's printed installation instructions.
- B. Install air curtains plumb, level, square, true to line, and weathertight, without warp or rack.

- C. Anchor air curtains securely in place to supports.
- D. Coordinate with sheet metal flashing as specified in Section 07 62 00.
- E. Install joint sealants as specified in Section 07 92 00.
- F. Coordinate with electrical power as specified in Section 26 05 00.
- G. Install door limit switches and adjust for correct operation.
- H. Provide connection to piped services and utilities as specified in Section 22 10 00 and 23 21 00.

3.3 FIELD QUALITY CONTROL

- A. Adjust air curtains to function properly.
- B. Adjust air foil vanes located within the discharge nozzle as required for prevailing conditions at each opening.
- C. Check heated air curtain performance on a calm day by measuring air temperature 6 inches off the floor. Optimal reading is halfway between the temperature inside and outside the building.

3.4 CLEANING

- A. Clean air curtains promptly after installation in accordance with manufacturer's instructions.
- B. Repair minor damages to finish in accordance with manufacturer's instructions and as approved by Architect.
- C. Remove and replace damaged components that cannot be successfully repaired as determined by Architect.

3.5 PROTECTION

- A. Protect materials and finish from damage until substantial completion.

3.6 SCHEDULES

- A. Refer to Air Curtain Schedule appended to this section.

END OF SECTION



BD14 Submittal Package

atmosphere is everything

14716 S. BROADWAY, GARDENA, CA 90248 • Ph: (310)532-1555 Fax: (310)-532-3030 • www.marsair.com
© Copyright Mars Air Systems, LLC 2014

Reference Links

Link

Description

<https://marsair.com>

Main website

<https://marsair.com/document-library>

**Submittals for all Mars Air Curtains,
Accessories, Installation, and Brochures**

<https://www.marsair.com/Content/Downloads/CSISpecs/BD14-CSI-Specification.doc>

Belt Drive 14 Series CSI spec (Word doc)